

Toshiba Ethernet Driver

© 2024 PTC Inc. All Rights Reserved.

Table of Contents

Toshiba Ethernet Driver	1
Table of Contents	2
Toshiba Ethernet Driver	4
Overview	4
Setup	4
Channel Properties — General	6
Tag Counts	7
Channel Properties — Ethernet Communications	7
Channel Properties — Write Optimizations	7
Channel Properties — Advanced	8
Device Properties — General	9
Operating Mode	10
Tag Counts	10
Device Properties — Scan Mode	11
Device Properties — Timing	11
Device Properties — Auto-Demotion	12
Device Properties — Communications Parameters	13
Device Properties — Redundancy	13
Optimizing Communications	14
Data Types Description	15
Address Descriptions	16
T2 Addressing	16
T3 Addressing	17
S2 Addressing	19
S3 Addressing	20
Error Descriptions	22
Address <address> is out of range for the specified device or register	22
Data Type <type> is not valid for device address <address>	22
Device address <address> contains a syntax error	22
Device address <address> is not supported by model <model name>	23
Device address <address> is read only	23
Missing address	23
Deactivating tag block. Bad address in block [<start address> to <end address>] on device <device name>	23
Device <device name> is not responding	24
Device <device name> responded with error code 'n' (Tag <tag name>)	24

Unable to write to address <address> on device <device name>	24
Winsock initialization failed (OS Error = n)	25
Winsock V1.1 or higher must be installed to use the Toshiba Ethernet Driver	25
Appendix: Hardware Configuration	26
S Series Setup	26
T2 and T3 Setup	31
Index	33

Toshiba Ethernet Driver

Help version 1.026

CONTENTS

Overview

What is the Toshiba Ethernet Driver?

Setup

How do I configure a specific device to work with this driver?

Optimizing Communications

How do I get the best performance from the Toshiba Ethernet Driver?

Data Types Description

What data types does this driver support?

Address Descriptions

How do I address a data location on a Toshiba device?

Error Descriptions

What error messages does the Toshiba Ethernet Driver produce?

Overview

The Toshiba Ethernet Driver provides a reliable way to connect Toshiba Ethernet devices to OPC client applications; including HMI, SCADA, Historian, MES, ERP, and countless custom applications.

It is important to understand the data types and the addressing scheme before using the Toshiba Ethernet Driver in an OPC server software project. *For more information, refer to [Data Types Description](#) and [Address Descriptions](#).*

Setup

Supported Devices

T2, T3, S2, and S3 PLCs with Ethernet option

Channel and Device Limits

The maximum number of channels supported by this driver is 100. The maximum number of devices supported by this driver is 32 per channel.

Device ID

This property specifies the device's IP address.

Communications Protocol

Toshiba ASCII Computer Link

Note: This driver requires Winsock V1.1 or higher.

Connection Timeout

This property specifies the time that the driver will wait for a connection to be made with a device. Depending on network load, the connect time may vary with each connection attempt. The default setting is 3 seconds. The valid range is 1 to 30 seconds.

Request Timeout

This property specifies the time that the driver will wait on a response from the device before giving up and going on to the next request. Longer timeouts only affect performance if a device is not responding. The default setting is 1000 milliseconds. The valid range is 50 to 9999999 milliseconds.

Retry Attempts

This property specifies the number of times the driver will retry a message before giving up and going on to the next message. The default setting is 3 retries. The valid range is 1 to 10.

Channel Properties — General

This server supports the use of multiple simultaneous communications drivers. Each protocol or driver used in a server project is called a channel. A server project may consist of many channels with the same communications driver or with unique communications drivers. A channel acts as the basic building block of an OPC link. This group is used to specify general channel properties, such as the identification attributes and operating mode.

Property Groups General Write Optimizations Advanced	<table border="1"> <tr> <td colspan="2">[-] Identification</td> </tr> <tr> <td>Name</td> <td></td> </tr> <tr> <td>Description</td> <td></td> </tr> <tr> <td>Driver</td> <td></td> </tr> <tr> <td colspan="2">[-] Diagnostics</td> </tr> <tr> <td>Diagnostics Capture</td> <td>Disable</td> </tr> <tr> <td colspan="2">[-] Tag Counts</td> </tr> <tr> <td>Static Tags</td> <td>10</td> </tr> </table>	[-] Identification		Name		Description		Driver		[-] Diagnostics		Diagnostics Capture	Disable	[-] Tag Counts		Static Tags	10
[-] Identification																	
Name																	
Description																	
Driver																	
[-] Diagnostics																	
Diagnostics Capture	Disable																
[-] Tag Counts																	
Static Tags	10																

Identification

Name: Specify the user-defined identity of this channel. In each server project, each channel name must be unique. Although names can be up to 256 characters, some client applications have a limited display window when browsing the OPC server's tag space. The channel name is part of the OPC browser information. The property is required for creating a channel.

• For information on reserved characters, refer to "How To... Properly Name a Channel, Device, Tag, and Tag Group" in the server help.

Description: Specify user-defined information about this channel.

• Many of these properties, including Description, have an associated system tag.

Driver: Specify the protocol / driver for this channel. Specify the device driver that was selected during channel creation. It is a disabled setting in the channel properties. The property is required for creating a channel.

• **Note:** With the server's online full-time operation, these properties can be changed at any time. This includes changing the channel name to prevent clients from registering data with the server. If a client has already acquired an item from the server before the channel name is changed, the items are unaffected. If, after the channel name has been changed, the client application releases the item and attempts to re-acquire using the old channel name, the item is not accepted. Changes to the properties should not be made once a large client application has been developed. Utilize proper user role and privilege management to prevent operators from changing properties or accessing server features.

Diagnostics

Diagnostics Capture: When enabled, this option makes the channel's diagnostic information available to OPC applications. Because the server's diagnostic features require a minimal amount of overhead processing, it is recommended that they be utilized when needed and disabled when not. The default is disabled.

• **Note:** This property is not available if the driver does not support diagnostics.

• For more information, refer to *Communication Diagnostics in the server help*.

Diagnostics

Diagnostics Capture: When enabled, this option allows the usage of statistics tags that provide feedback to client applications regarding the operation of the channel. Because the server's diagnostic features require a minimal amount of overhead processing, it is recommended that they be utilized when needed and disabled when not. The default is disabled.

● **Note:** This property is not available if the driver does not support diagnostics.

● *For more information, refer to Statistics Tags in the server help.*

Tag Counts

Static Tags: Provides the total number of defined static tags at this level (device or channel). This information can be helpful in troubleshooting and load balancing.

Channel Properties — Ethernet Communications

Ethernet Communication can be used to communicate with devices.

Property Groups	Ethernet Settings	
General	Network Adapter	Default
Ethernet Communications		
Write Optimizations		
Advanced		

Ethernet Settings

Network Adapter: Specify the network adapter to bind. When left blank or Default is selected, the operating system selects the default adapter.

Channel Properties — Write Optimizations

The server must ensure that the data written from the client application gets to the device on time. Given this goal, the server provides optimization properties to meet specific needs or improve application responsiveness.

Property Groups	Write Optimizations	
General	Optimization Method	Write Only Latest Value for All Tags
Write Optimizations	Duty Cycle	10

Write Optimizations

Optimization Method: Controls how write data is passed to the underlying communications driver. The options are:

- **Write All Values for All Tags:** This option forces the server to attempt to write every value to the controller. In this mode, the server continues to gather write requests and add them to the server's internal write queue. The server processes the write queue and attempts to empty it by writing data to the device as quickly as possible. This mode ensures that everything written from the client applications is sent to the target device. This mode should be selected if the write operation order or the write item's content must uniquely be seen at the target device.

- **Write Only Latest Value for Non-Boolean Tags:** Many consecutive writes to the same value can accumulate in the write queue due to the time required to actually send the data to the device. If the server updates a write value that has already been placed in the write queue, far fewer writes are needed to reach the same final output value. In this way, no extra writes accumulate in the server's queue. When the user stops moving the slide switch, the value in the device is at the correct value at virtually the same time. As the mode states, any value that is not a Boolean value is updated in the server's internal write queue and sent to the device at the next possible opportunity. This can greatly improve the application performance.
 - **Note:** This option does not attempt to optimize writes to Boolean values. It allows users to optimize the operation of HMI data without causing problems with Boolean operations, such as a momentary push button.
- **Write Only Latest Value for All Tags:** This option takes the theory behind the second optimization mode and applies it to all tags. It is especially useful if the application only needs to send the latest value to the device. This mode optimizes all writes by updating the tags currently in the write queue before they are sent. This is the default mode.

Duty Cycle: is used to control the ratio of write to read operations. The ratio is always based on one read for every one to ten writes. The duty cycle is set to ten by default, meaning that ten writes occur for each read operation. Although the application is performing a large number of continuous writes, it must be ensured that read data is still given time to process. A setting of one results in one read operation for every write operation. If there are no write operations to perform, reads are processed continuously. This allows optimization for applications with continuous writes versus a more balanced back and forth data flow.

● **Note:** It is recommended that the application be characterized for compatibility with the write optimization enhancements before being used in a production environment.

Channel Properties — Advanced

This group is used to specify advanced channel properties. Not all drivers support all properties; so the Advanced group does not appear for those devices.

Property Groups	<input type="checkbox"/> Non-Normalized Float Handling	
General	Floating-Point Values	Replace with Zero
Write Optimizations	<input type="checkbox"/> Inter-Device Delay	
Advanced	Inter-Device Delay (ms)	0

Non-Normalized Float Handling: A non-normalized value is defined as Infinity, Not-a-Number (NaN), or as a Denormalized Number. The default is Replace with Zero. Drivers that have native float handling may default to Unmodified. Non-normalized float handling allows users to specify how a driver handles non-normalized IEEE-754 floating point data. Descriptions of the options are as follows:

- **Replace with Zero:** This option allows a driver to replace non-normalized IEEE-754 floating point values with zero before being transferred to clients.
- **Unmodified:** This option allows a driver to transfer IEEE-754 denormalized, normalized, non-number, and infinity values to clients without any conversion or changes.

● **Note:** This property is disabled if the driver does not support floating-point values or if it only supports the option that is displayed. According to the channel's float normalization setting, only real-time driver tags (such as values and arrays) are subject to float normalization. For example, EFM data is not affected by this setting.

For more information on the floating-point values, refer to "How To ... Work with Non-Normalized Floating-Point Values" in the server help.

Inter-Device Delay: Specify the amount of time the communications channel waits to send new requests to the next device after data is received from the current device on the same channel. Zero (0) disables the delay.

Note: This property is not available for all drivers, models, and dependent settings.

Device Properties — General

A device represents a single target on a communications channel. If the driver supports multiple controllers, users must enter a device ID for each controller.

Property Groups	Identification	
General	Name	
Scan Mode	Description	
	Channel Assignment	
	Driver	
	Model	
	ID Format	Decimal
	ID	2

Identification

Name: Specify the name of the device. It is a logical user-defined name that can be up to 256 characters long and may be used on multiple channels.

Note: Although descriptive names are generally a good idea, some OPC client applications may have a limited display window when browsing the OPC server's tag space. The device name and channel name become part of the browse tree information as well. Within an OPC client, the combination of channel name and device name would appear as "ChannelName.DeviceName".

For more information, refer to "How To... Properly Name a Channel, Device, Tag, and Tag Group" in server help.

Description: Specify the user-defined information about this device.

Many of these properties, including Description, have an associated system tag.

Channel Assignment: Specify the user-defined name of the channel to which this device currently belongs.

Driver: Selected protocol driver for this device.

Model: Specify the type of device that is associated with this ID. The contents of the drop-down menu depend on the type of communications driver being used. Models that are not supported by a driver are disabled. If the communications driver supports multiple device models, the model selection can only be changed when there are no client applications connected to the device.

Note: If the communication driver supports multiple models, users should try to match the model selection to the physical device. If the device is not represented in the drop-down menu, select a model that conforms closest to the target device. Some drivers support a model selection called "Open," which allows users to communicate without knowing the specific details of the target device. For more information, refer to the driver documentation.

ID: Specify the device's driver-specific station or node. The type of ID entered depends on the communications driver being used. For many communication drivers, the ID is a numeric value. Drivers that support a Numeric ID provide users with the option to enter a numeric value whose format can be changed to suit the needs of the application or the characteristics of the selected communications driver. The format is set by the driver by default. Options include Decimal, Octal, and Hexadecimal.

● **Note:** If the driver is Ethernet-based or supports an unconventional station or node name, the device's TCP/IP address may be used as the device ID. TCP/IP addresses consist of four values that are separated by periods, with each value in the range of 0 to 255. Some device IDs are string based. There may be additional properties to configure within the ID field, depending on the driver.

Operating Mode

Property Groups	+ Identification	
General	- Operating Mode	
Scan Mode	Data Collection	Enable
	Simulated	No

Data Collection: This property controls the device's active state. Although device communications are enabled by default, this property can be used to disable a physical device. Communications are not attempted when a device is disabled. From a client standpoint, the data is marked as invalid and write operations are not accepted. This property can be changed at any time through this property or the device system tags.

Simulated: Place the device into or out of Simulation Mode. In this mode, the driver does not attempt to communicate with the physical device, but the server continues to return valid OPC data. Simulated stops physical communications with the device, but allows OPC data to be returned to the OPC client as valid data. While in Simulation Mode, the server treats all device data as reflective: whatever is written to the simulated device is read back and each OPC item is treated individually. The data is not saved if the server removes the item (such as when the server is reinitialized). The default is No.

● Notes:

1. Updates are not applied until clients disconnect and reconnect.
2. The System tag (_Simulated) is read only and cannot be written to for runtime protection. The System tag allows this property to be monitored from the client.
3. In Simulation mode, the item's memory map is based on client update rate(s) (Group Update Rate for OPC clients or Scan Rate for native and DDE interfaces). This means that two clients that reference the same item with different update rates return different data.
4. When a device is simulated, updates may not appear faster than one (1) second in the client.

● Simulation Mode is for test and simulation purposes only. It should never be used in a production environment.

Tag Counts

Property Groups	- Identification	
General	- Operating Mode	
	- Tag Counts	
	Static Tags	130

Static Tags: Provides the total number of defined static tags at this level (device or channel). This information can be helpful in troubleshooting and load balancing.

Device Properties — Scan Mode

The Scan Mode specifies the subscribed-client requested scan rate for tags that require device communications. Synchronous and asynchronous device reads and writes are processed as soon as possible; unaffected by the Scan Mode properties.

Property Groups	[-] Scan Mode	
General	Scan Mode	Respect Client-Specified Scan Rate ▾
Scan Mode	Initial Updates from Cache	Disable

Scan Mode: Specify how tags in the device are scanned for updates sent to subscribing clients. Descriptions of the options are:

- **Respect Client-Specified Scan Rate:** This mode uses the scan rate requested by the client.
- **Request Data No Faster than Scan Rate:** This mode specifies the value set as the maximum scan rate. The valid range is 10 to 99999990 milliseconds. The default is 1000 milliseconds.
 - **Note:** When the server has an active client and items for the device and the scan rate value is increased, the changes take effect immediately. When the scan rate value is decreased, the changes do not take effect until all client applications have been disconnected.
- **Request All Data at Scan Rate:** This mode forces tags to be scanned at the specified rate for subscribed clients. The valid range is 10 to 99999990 milliseconds. The default is 1000 milliseconds.
- **Do Not Scan, Demand Poll Only:** This mode does not periodically poll tags that belong to the device nor perform a read to get an item's initial value once it becomes active. It is the OPC client's responsibility to poll for updates, either by writing to the `_DemandPoll` tag or by issuing explicit device reads for individual items. *For more information, refer to "Device Demand Poll" in server help.*
- **Respect Tag-Specified Scan Rate:** This mode forces static tags to be scanned at the rate specified in their static configuration tag properties. Dynamic tags are scanned at the client-specified scan rate.

Initial Updates from Cache: When enabled, this option allows the server to provide the first updates for newly activated tag references from stored (cached) data. Cache updates can only be provided when the new item reference shares the same address, scan rate, data type, client access, and scaling properties. A device read is used for the initial update for the first client reference only. The default is disabled; any time a client activates a tag reference the server attempts to read the initial value from the device.

Device Properties — Timing

The device Timing properties allow the driver's response to error conditions to be tailored to fit the application's needs. In many cases, the environment requires changes to these properties for optimum performance. Factors such as electrically generated noise, modem delays, and poor physical connections can influence how many errors or timeouts a communications driver encounters. Timing properties are specific to each configured device.

Property Groups	[-] Communication Timeouts	
General	Connect Timeout (s)	3
Scan Mode	Request Timeout (ms)	1000
Timing	Attempts Before Timeout	3

Communications Timeouts

Connect Timeout: This property (which is used primarily by Ethernet based drivers) controls the amount of time required to establish a socket connection to a remote device. The device's connection time often takes longer than normal communications requests to that same device. The valid range is 1 to 30 seconds. The default is typically 3 seconds, but can vary depending on the driver's specific nature. If this setting is not supported by the driver, it is disabled.

● **Note:** Due to the nature of UDP connections, the connection timeout setting is not applicable when communicating via UDP.


Request Timeout: Specify an interval used by all drivers to determine how long the driver waits for a response from the target device to complete. The valid range is 50 to 9999999 milliseconds (167 minutes). The default is usually 1000 milliseconds, but can vary depending on the driver. The default timeout for most serial drivers is based on a baud rate of 9600 baud or better. When using a driver at lower baud rates, increase the timeout to compensate for the increased time required to acquire data.

Attempts Before Timeout: Specify how many times the driver issues a communications request before considering the request to have failed and the device to be in error. The valid range is 1 to 10. The default is typically 3, but can vary depending on the driver's specific nature. The number of attempts configured for an application depends largely on the communications environment. This property applies to both connection attempts and request attempts.

Timing

Inter-Request Delay: Specify how long the driver waits before sending the next request to the target device. It overrides the normal polling frequency of tags associated with the device, as well as one-time reads and writes. This delay can be useful when dealing with devices with slow turnaround times and in cases where network load is a concern. Configuring a delay for a device affects communications with all other devices on the channel. It is recommended that users separate any device that requires an inter-request delay to a separate channel if possible. Other communications properties (such as communication serialization) can extend this delay. The valid range is 0 to 300,000 milliseconds; however, some drivers may limit the maximum value due to a function of their particular design. The default is 0, which indicates no delay between requests with the target device.

● **Note:** Not all drivers support Inter-Request Delay. This setting does not appear if it is not available.

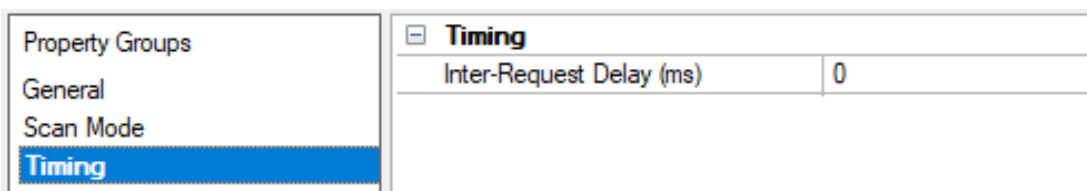

Device Properties — Auto-Demotion

The Auto-Demotion properties can temporarily place a device off-scan in the event that a device is not responding. By placing a non-responsive device offline for a specific time period, the driver can continue to optimize its communications with other devices on the same channel. After the time period has been reached, the driver re-attempts to communicate with the non-responsive device. If the device is responsive, the device is placed on-scan; otherwise, it restarts its off-scan time period.

Property Groups	<input type="checkbox"/> Auto-Demotion	
General	Demote on Failure	Enable
Scan Mode	Timeouts to Demote	3
Timing	Demotion Period (ms)	10000
Auto-Demotion	Discard Requests when Demoted	Disable

Demote on Failure: When enabled, the device is automatically taken off-scan until it is responding again.

Tip: Determine when a device is off-scan by monitoring its demoted state using the `_AutoDemoted` system tag.

Timeouts to Demote: Specify how many successive cycles of request timeouts and retries occur before the device is placed off-scan. The valid range is 1 to 30 successive failures. The default is 3.

Demotion Period: Indicate how long the device should be placed off-scan when the timeouts value is reached. During this period, no read requests are sent to the device and all data associated with the read requests are set to bad quality. When this period expires, the driver places the device on-scan and allows for another attempt at communications. The valid range is 100 to 3600000 milliseconds. The default is 10000 milliseconds.

Discard Requests when Demoted: Select whether or not write requests should be attempted during the off-scan period. Disable to always send write requests regardless of the demotion period. Enable to discard writes; the server automatically fails any write request received from a client and does not post a message to the Event Log.

Device Properties — Communications Parameters

Property Groups	<input type="checkbox"/> Communications Parameters	
General	Maximum Request Size (bytes)	256
Scan Mode		
Communications Parameters		

Port: Configure the Ethernet port to be used when connecting to the device.

Device Properties — Redundancy

Property Groups	<input type="checkbox"/> Redundancy	
General	Secondary Path	Channel.Device 1 ...
Scan Mode	Operating Mode	Switch On Failure
Timing	Monitor Item	
Auto-Demotion	Monitor Interval (s)	300
Tag Generation	Return to Primary ASAP	Yes
Tag Import Settings		
Redundancy		


Redundancy is available with the Media-Level Redundancy Plug-In.

Tip: Consult the website, a sales representative, or the [user manual](#) for more information.


Optimizing Communications

The Toshiba Ethernet Driver has been designed to provide the best performance with the least amount of impact on the system's overall performance. While the Toshiba Ethernet Driver is fast, there are a couple of guidelines that can be used to control and optimize the application and gain maximum performance. This server refers to communications protocols like Toshiba Ethernet as a channel.

Each channel defined in the application represents a separate path of execution in the server. Once a channel has been defined, a series of devices must then be defined under that channel. Each of these devices represents a single Toshiba Ethernet controller from which data will be collected. While this approach to defining the application will provide a high level of performance, it won't take full advantage of the Toshiba Ethernet Driver or the network. An example of how the application may appear when configured using a single channel is shown below.

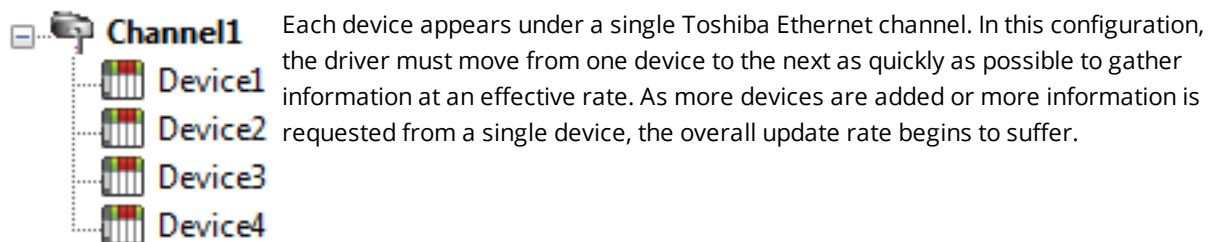

If the Toshiba Ethernet Driver could only define one single channel, then the example shown above would be the only option available; however, the Toshiba Ethernet Driver can define up to 100 channels. Using multiple channels distributes the data collection workload by simultaneously issuing multiple requests to the network. An example of how the same application may appear when configured using multiple channels to improve performance is shown below.

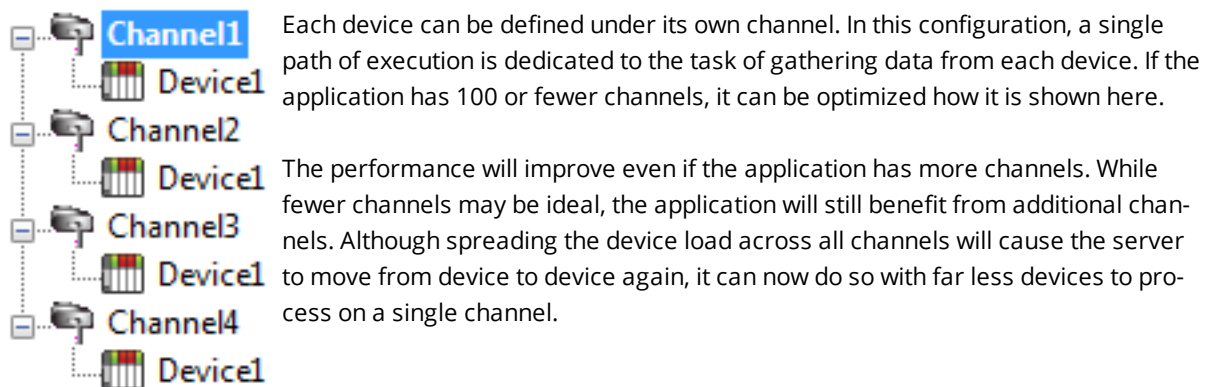

Data Types Description

Data Type	Description
Boolean	Single bit
Word	Unsigned 16-bit value bit 0 is the least significant bit bit 15 the most significant bit
Short	Signed 16-bit value bit 0 is the least significant bit bit 14 the most significant bit bit 15 is the sign bit
DWord	Unsigned 32-bit value bit 0 is the least significant bit bit 31 the most significant bit
Long	Signed 32-bit value bit 0 is the least significant bit bit 30 the most significant bit bit 31 is the sign bit
Float	32-bit floating-point value The driver interprets two consecutive registers as a floating point value by making the second register the high word and the first register the low word.
String	Null-terminated ASCII string Supported on all models, includes HiLo LoHi byte order selection.

Address Descriptions

Address specifications vary depending on the model in use. Select a link from the following list to obtain specific address information for the model of interest.

[T2 Addressing](#)

[T3 Addressing](#)

[S2 Addressing](#)

[S3 Addressing](#)

T2 Addressing

The default data types for dynamically defined tags are shown in **bold** where appropriate.

Address Type	Range	Data Type	Access
Input Devices	X00...X0F-X127...X127F	Boolean	Read/Write
Direct Input Devices	I00...I0F-I127...I127F	Boolean	Read Only
Output Devices	Y00...Y0F-Y127...Y127F	Boolean	Read/Write
Direct Output Devices	O00...O0F-O127...O127F	Boolean	Read/Write
Input Registers	XW0-XW127 XW0-WW126	Word , Short DWord, Long, Float	Read/Write
Direct Input Registers	IW0-IW127 IW0-IW126	Word , Short DWord, Long, Float	Read/write
Output Registers	YW0-YW127 YW0-YW126	Word , Short DWord, Long, Float	Read/Write
Direct Output Registers	OW0-OW127 OW0-OW126	Word , Short DWord, Long, Float	Read/Write
Link Relays	L00...L0F-L2550...L255F	Boolean	Read/Write
Link Registers	LW0-LW255 LW0-LW254	Word , Short DWord, Long, Float	Read/Write
Link Registers	W0-W1023 W0-W1022	Word , Short DWord, Long, Float	Read/Write
Link Register relays	Z00...Z0F-Z5110...Z511F	Boolean	Read/Write
File Registers	F0-F1023 F0-F1022	Word , Short DWord, Long, Float	Read/Write
Auxiliary Devices	R00...R0F-R2550...R255F	Boolean	Read/Write
Auxiliary Registers	RW0-RW255 RW0-RW254	Word , Short DWord, Long, Float	Read/Write

Address Type	Range	Data Type	Access
Special Devices	S00...S0F-S2550...S255F	Boolean	Read/Write
Special Registers	SW0-SW255 SW0-SW254	Word , Short DWord, Long, Float	Read Only
Counter Registers	C0-C255	Word , Short	Read/Write
Counter Devices	C.0-C.255	Boolean	Read Only
Timer Registers	T0-T255	Word , Short	Read/Write
Timer Devices	T.0-T.255	Boolean	Read Only
Data Memory	D0-D8191 D0-D8190	Word , Short DWord, Long, Float	Read/Write
Data Memory As String with HiLo Byte Order	D0.2H-D4095.64H .Bit is string length, range 2 to 64 bytes.	String	Read/Write
Data Memory As String with LoHi Byte Order	D0.2L-D4095.64L .Bit is string length, range 2 to 64 bytes.	String	Read/Write

String Support

The Toshiba Ethernet Driver supports reading and writing Data registers as an ASCII string. When using Data registers for string data, each register will contain two bytes of ASCII data. The order of the ASCII data within a given register can be selected when the string is defined. The length of the string can be from 2 to 64 bytes and is entered in place of a bit number. The length must be entered as an even number. The byte order is specified by appending either an "H" or "L" to the address.

Examples

1. To address a string starting at D200 with a length of 50 bytes and HiLo byte order, enter: D200.50H
2. To address a string starting at D500 with a length of 38 bytes and LoHi byte order, enter: D500.38L

T3 Addressing

The default data types for dynamically defined tags are shown in **bold** where appropriate.

Address Type	Range	Data Type	Access
Input Devices	X00...X0F-X5110...X511F	Boolean	Read/Write
Direct Input Devices	I00...I0F-I5110...I511F	Boolean	Read Only
Output Devices	Y00...Y0F-Y5110...Y511F	Boolean	Read/Write
Direct Output Devices	O00...O0F- O5110...O511F	Boolean	Read/Write
Input Registers	XW0-XW511 XW0-XW510	Word , Short DWord, Long, Float	Read/Write
Direct Input Registers	IW0-IW511 IW0-IW510	Word , Short DWord, Long,	Read/Write

Address Type	Range	Data Type	Access
		Float	
Output Registers	YW0-YW511 YW0-YW510	Word , Short DWord, Long, Float	Read/Write
Direct Output Registers	OW0-OW511 OW0-OW510	Word , Short DWord, Long, Float	Read/Write
Link Relays	L00...L0F-L2550...L255F	Boolean	Read/Write
Link Registers	LW0-LW255 LW0-LW254	Word , Short DWord, Long, Float	Read/Write
Link Registers	W0-W2047 W0-W2026	Word , Short DWord, Long, Float	Read/Write
Link Register relays	Z00...Z0F-Z9990...Z999F	Boolean	Read/Write
File Registers	F0-F8191 F0-F8190	Word , Short DWord, Long, Float	Read/Write
Auxiliary Devices	R00...R0F-R9990...R999F	Boolean	Read/Write
Auxiliary Registers	RW0-RW999 RW0-RW998	Word , Short DWord, Long, Float	Read/Write
Special Devices	S00...S0F-S2550...S255F	Boolean	Read/Write
Special Registers	SW0-SW255 SW0-SW254	Word , Short DWord, Long, Float	Read Only
Counter Registers	C0-C511	Word , Short	Read/Write
Counter Devices	C.0-C.511	Boolean	Read Only
Timer Registers	T0-T999	Word , Short	Read/Write
Timer Devices	T.0-T.999	Boolean	Read Only
Data Memory	D0-D8191 D0-D8190	Word , Short DWord, Long, Float	Read/Write
Data Memory As String with HiLo Byte Order	D0.2H-D8191.64H .Bit is string length, range 2 to 64 bytes.	String	Read/Write
Data Memory As String with LoHi Byte Order	D0.2L-D8191.64L .Bit is string length, range 2 to 64 bytes.	String	Read/Write

String Support

The Toshiba Ethernet Driver supports reading and writing Data registers as an ASCII string. When using Data registers for string data, each register will contain two bytes of ASCII data. The order of the ASCII data within a given register can be selected when the string is defined. The length of the string can be from 2 to

64 bytes and is entered in place of a bit number. The length must be entered as an even number. The byte order is specified by appending either a "H" or "L" to the address.

Examples

1. To address a string starting at D200 with a length of 50 bytes and HiLo byte order, enter: D200.50H
2. To address a string starting at D500 with a length of 38 bytes and LoHi byte order, enter: D500.38L

S2 Addressing

The default data types for dynamically defined tags are shown in **bold** where appropriate.

Address Type	Range	Data Type	Access
Input Devices	X0 0...X0 F-X3071 0...X3071 F	Boolean*	Read/Write
Direct Input Devices	I0 0...I0 F-I3071 0...I3071 F	Boolean*	Read Only
Output Devices	Y0 0...Y0 F-Y3071 0...Y3071 F	Boolean*	Read/Write
Direct Output Devices	O0 0...O0 F-O3071 0...O3071 F	Boolean*	Read/Write
Input Registers	XW0-XW3071 XW0-XW3070	Word , Short DWord, Long, Float	Read/Write
Direct Input Registers	IW0-IW3071 IW0-IW3070	Word , Short DWord, Long, Float	Read/Write
Output Registers	YW0-YW3071 YW0-YW3070	Word , Short DWord, Long, Float	Read/Write
Direct Output Registers	OW0-OW3071 OW0-OW3070	Word , Short DWord, Long, Float	Read/Write
Auxiliary Devices	R0 0...R0 F-R4095 0...R4095 F	Boolean*	Read/Write
Auxiliary Devices	D[0].B[0]-D[4095].B[F]	Boolean*	Read/Write
Auxiliary Registers	RW0-RW4095 RW0-RW4094	Word , Short DWord, Long, Float	Read/Write
Auxiliary Registers	DW[0]-DW[4095] DW[0]-DW[4094]	Word , Short DWord, Long, Float	Read/Write
Special Devices	S0 0...S0 F-S511 0...S511 F	Boolean*	Read/Write
Special Registers	SW0-SW511 SW0-SW510	Word , Short DWord, Long, Float	Read Only
Data Memory	D0-D4095 D0-D4094	Word , Short DWord, Long,	Read/Write

Address Type	Range	Data Type	Access
		Float	
Data Memory As String with HiLo Byte Order	D0.64H-D4095.2H .Bit is string length, range 2 to 64 bytes.	String	Read/Write
Data Memory As String with LoHi Byte Order	D0.64L-D4095.2L .Bit is string length, range 2 to 64 bytes.	String	Read/Write

*The last character in the address is the bit identifier and is represented in hexadecimal format.

String Support

The Toshiba Ethernet Driver supports reading and writing Data registers as an ASCII string. When using Data registers for string data, each register will contain two bytes of ASCII data. The order of the ASCII data within a given register can be selected when the string is defined. The length of the string can be from 2 to 64 bytes and is entered in place of a bit number. The length must be entered as an even number. The byte order is specified by appending either an "H" or "L" to the address.

Examples

1. To address a string starting at D200 with a length of 50 bytes and HiLo byte order, enter: D200.50H
2. To address a string starting at D500 with a length of 38 bytes and LoHi byte order, enter: D500.38L

S3 Addressing

The default data types for dynamically defined tags are shown in **bold** where appropriate.

Address Type	Range	Data Type	Access
Input Devices	X0 0...X0 F-X5119 0...X5119 F	Boolean*	Read/Write
Direct Input Devices	I0 0...I0 F-I5119 0...I5119 F	Boolean*	Read Only
Output Devices	Y0 0...Y0 F-Y5119 0...Y5119 F	Boolean*	Read/Write
Direct Output Devices	O0 0...O0 F-O5119 0...O5119 F	Boolean*	Read/Write
Input Registers	XW0-XW5119 XW0-XW5118	Word , Short DWord, Long, Float	Read/Write
Direct Input Registers	IW0-IW5119 IW0-IW5118	Word , Short DWord, Long, Float	Read/Write
Output Registers	YW0-YW5119 YW0-YW5118	Word , Short DWord, Long, Float	Read/Write
Direct Output Registers	OW0-OW5119 OW0-OW5118	Word , Short DWord, Long, Float	Read/Write

Address Type	Range	Data Type	Access
Auxiliary Devices	R0 0...R0 F-R4095 0...R4095 F	Boolean*	Read/Write
Auxiliary Devices	D[0].B[0]-D[4095].B[F]	Boolean*	Read/Write
Auxiliary Registers	RW0-RW4095 RW0-RW4094	Word , Short DWord, Long, Float	Read/Write
Auxiliary Registers	DW[0]-DW[4095] DW[0]-DW[4094]	Word , Short DWord, Long, Float	Read/Write
Special Devices	S0 0...S0 F-S511 0...S511 F	Boolean*	Read/Write
Special Registers	SW0-SW511 SW0-SW510	Word , Short DWord, Long, Float	Read Only
Data Memory	D0-D4095 D0-D4094	Word , Short DWord, Long, Float	Read/Write
Data Memory As String with HiLo Byte Order	D0.64H-D4095.2H .Bit is string length, range 2 to 64 bytes.	String	Read/Write
Data Memory As String with LoHi Byte Order	D0.64L-D4095.2L .Bit is string length, range 2 to 64 bytes.	String	Read/Write

*The last character in the address is the bit identifier and is represented in hexadecimal format.

String Support

The Toshiba Ethernet Driver supports reading and writing Data registers as an ASCII string. When using Data registers for string data, each register will contain two bytes of ASCII data. The order of the ASCII data within a given register can be selected when the string is defined. The length of the string can be from 2 to 64 bytes and is entered in place of a bit number. The length must be entered as an even number. The byte order is specified by appending either an "H" or "L" to the address.

Examples

1. To address a string starting at D200 with a length of 50 bytes and HiLo byte order, enter: D200.50H
2. To address a string starting at D500 with a length of 38 bytes and LoHi byte order, enter: D500.38L

Error Descriptions

The following error/warning messages may be generated. Click on the link for a description of the message.

Address Validation

[Missing address](#)

[Device address <address> contains a syntax error](#)

[Address <address> is out of range for the specified device or register](#)

[Device address <address> is not supported by model <model name>](#)

[Data Type <type> is not valid for device address <address>](#)

[Device address <address> is Read Only](#)

Device Status Messages

[Winsock initialization failed \(OS Error = n\)](#)

[Winsock V1.1 or higher must be installed to use the Toshiba Ethernet device driver](#)

[Device <device name> is not responding](#)

[Unable to write to <address> on device <device name>](#)

[Device <device name> responded with error code 'n' \(Tag <tag name>\)](#)

[Deactivating tag block. Bad address in block \[<start address> to <end address>\] on device <device name>](#)

Address <address> is out of range for the specified device or register

Error Type:

Warning

Possible Cause:

A tag address that has been specified statically references a location that is beyond the range of supported locations for the device.

Solution:

Verify that the address is correct; if it is not, re-enter it in the client application.

Data Type <type> is not valid for device address <address>

Error Type:

Warning

Possible Cause:

A tag address that has been specified statically has been assigned an invalid data type.

Solution:

Modify the requested data type in the client application.

Device address <address> contains a syntax error

Error Type:

Warning

Possible Cause:

A tag address that has been specified statically contains one or more invalid characters.

Solution:

Re-enter the address in the client application.

Device address <address> is not supported by model <model name>

Error Type:

Warning

Possible Cause:

A tag address that has been specified statically references a location that is valid for the communications protocol but not supported by the target device.

Solution:

1. Verify that the address is correct; if it is not, re-enter it in the client application.
2. Verify the selected model name for the device is correct.

Device address <address> is read only

Error Type:

Warning

Possible Cause:

A tag address that has been specified statically has a requested access mode that is not compatible with what the device supports for that address.

Solution:

Change the access mode in the client application.

Missing address

Error Type:

Warning

Possible Cause:

A tag address that has been specified statically has no length.

Solution:

Re-enter the address in the client application.

Deactivating tag block. Bad address in block [<start address> to <end address>] on device <device name>

Error Type:

Warning

Possible Cause:

The driver is requesting a block of data with one or more invalid addresses.

Solution:

Verify that all addresses in specified range are valid for the device.

Device <device name> is not responding

Error Type:

Serious

Possible Cause:

1. The named device may not be connected to the PLC network.
2. The named device may have been assigned an incorrect Network ID.
3. The response from the device took longer to receive than the amount of time specified in the "Request Timeout" device setting.

Solution:

1. Check the PLC network connections.
2. Verify that the Network ID given to the named device matches that of the actual device.
3. Increase the Request Timeout setting so that the entire response can be handled.

Device <device name> responded with error code 'n' (Tag <tag name>)

Error Type:

Warning

Possible Cause:

The device responded with specified error code.

Solution:

Consult the Toshiba documentation for explanation of code and suggested solution.

Unable to write to address <address> on device <device name>

Error Type:

Serious

Possible Cause:

1. The serial connection between the device and the Host PC is broken.
2. The communications properties for the serial connection are incorrect.
3. The named device may have been assigned an incorrect Network ID.

Solution:

1. Verify the cabling between the PC and the PLC device.
2. Verify that the specified communications properties match those of the device.
3. Verify that the Network ID given to the named device matches that of the actual device.

Winsock initialization failed (OS Error = n)

Error Type:

Fatal

OS Error	Indication	Possible Solution
10091	Indicates that the underlying network subsystem is not ready for network communication.	Wait a few seconds and restart the driver.
10067	Limit on the number of tasks supported by the Windows Sockets implementation has been reached.	Close one or more applications that may be using Winsock and restart the driver.

Winsock V1.1 or higher must be installed to use the Toshiba Ethernet Driver

Error Type:

Fatal

Possible Cause:

The version number of the Winsock DLL found on the system is less than 1.1.

Solution:

Upgrade Winsock to version 1.1 or higher.

Appendix: Hardware Configuration

The hardware must be configured before Ethernet communications is possible. For more information about a specific hardware series, refer to the links below.

[S Series Setup](#)

[T2 and T3 Setup](#)

S Series Setup

To make a connection to the EN731 BNC, users must have two 50 ohm connectors: one on each end of the cable T connectors. Both ends require a T connector with the 50 ohm terminator.

Connecting to a V Series Using the Engineering Tool 2


A ladder is not required for the V series devices to communicate. For more information, refer to the instructions below.

1. To start, right-click on the **System** folder and select **New**. Name the new project and then double-click the newly created project icon. This will create a tree with the topics **Libraries, Networks, and Stations** in the lower left quadrant of the display.




2. Right-click on **Stations** and then select **New**. Select the model as desired.


Note: For the S3 CPUs, choose model 3000.

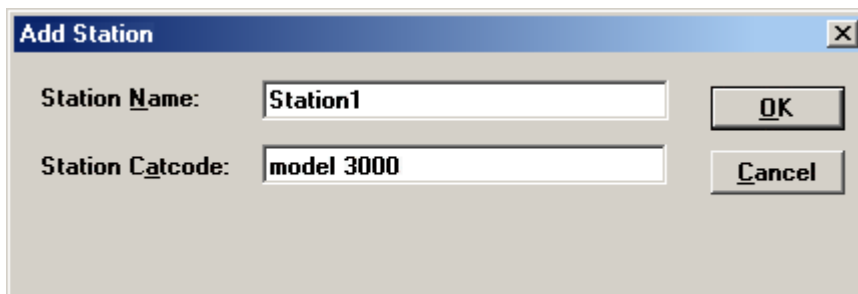

- Right-click on **Units** and then select **New**. In this dialog, choose the main board, backplane and model number (such as BU748). This will create a **Modules** subfolder.
- Next, right-click on **Modules** and select **New**.
- Select the slot number and CPU model and then click **OK**.

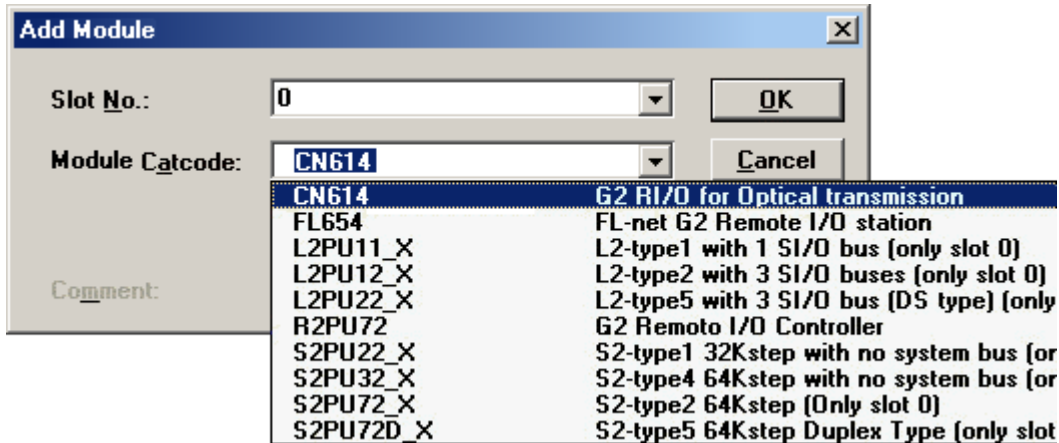


- Select the Ethernet model and then click **OK**.

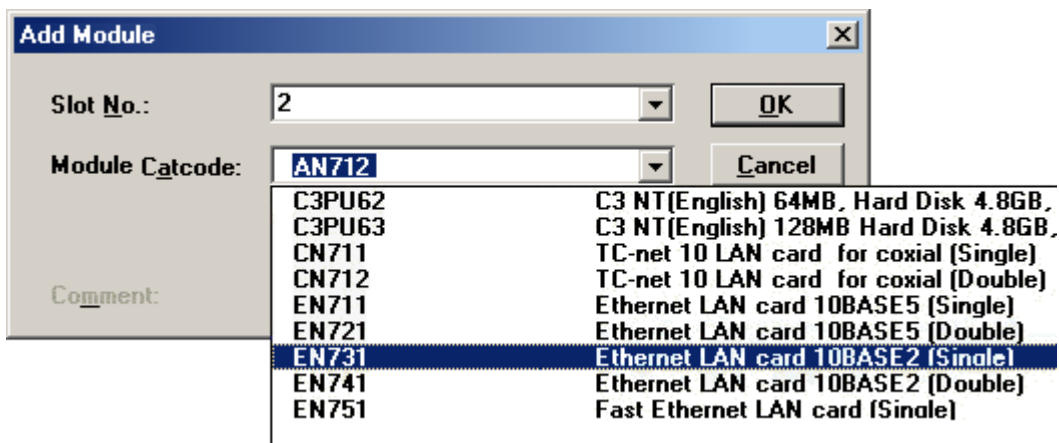


- Next, right-click on the CPU module and then click **Module Parameters | Tool and Module**. Scroll through the parameters until "Computer Link1 Ethernet Slot" and "...UDP PortNo" are located.
- Enter the Ethernet module's slot number and the desired port number. Then, enter the slot number and port number in both the Tool column and the Module column.

Notes:


- Not all screens will appear as the image shown below.
 - It is possible to assign more than one CPU and port to a given Ethernet module.
- Ensure the device is set to **Halt Mode** by turning the key, and then click **Write** from the module and parameters window. A write successful message will appear upon completion. Close the window.

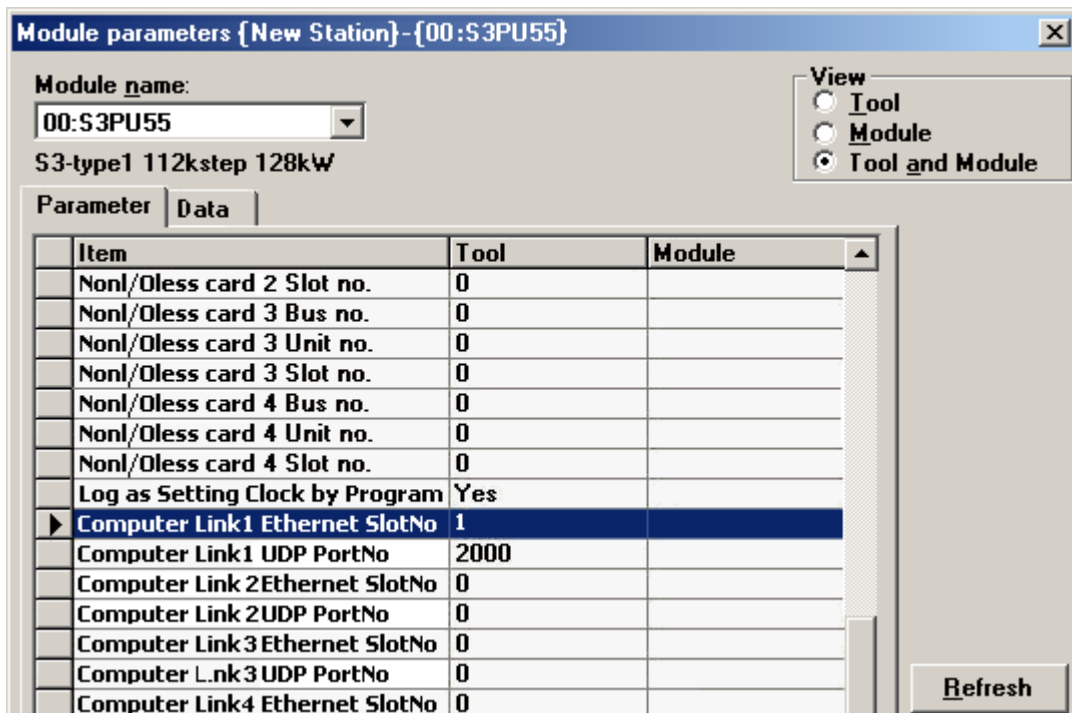


10. Right-click on the Ethernet module and then select **Module Parameters**.
11. Next, click **Tool and Module**. In the Tool column, enter the desired IP and subnet mask. Leave the **IP Address Type** set to Class B.

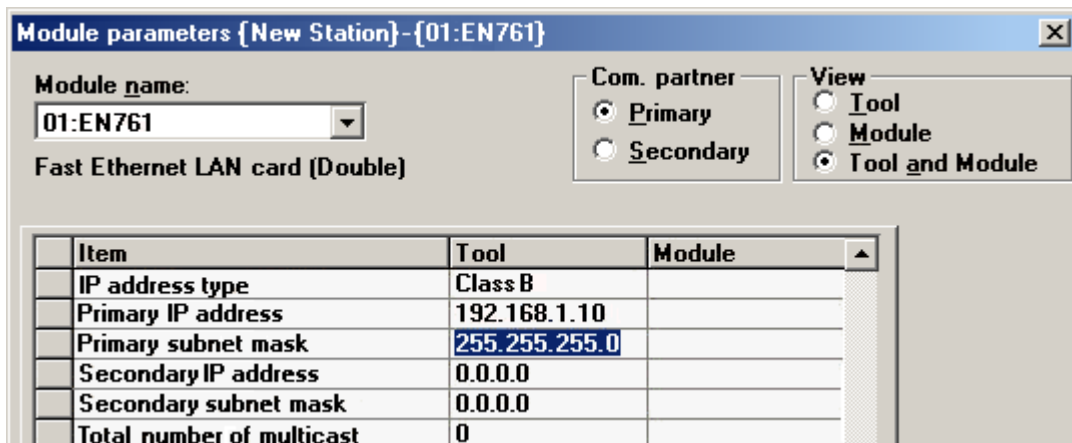


12. Click **Download** to write the information to the module. Then, close the window.
13. Click the **Network** folder from the tree and then select **New**. For a 3000 series project using an EN model Ethernet, select "EtherLAN" for the network. This will create a Module subfolder.

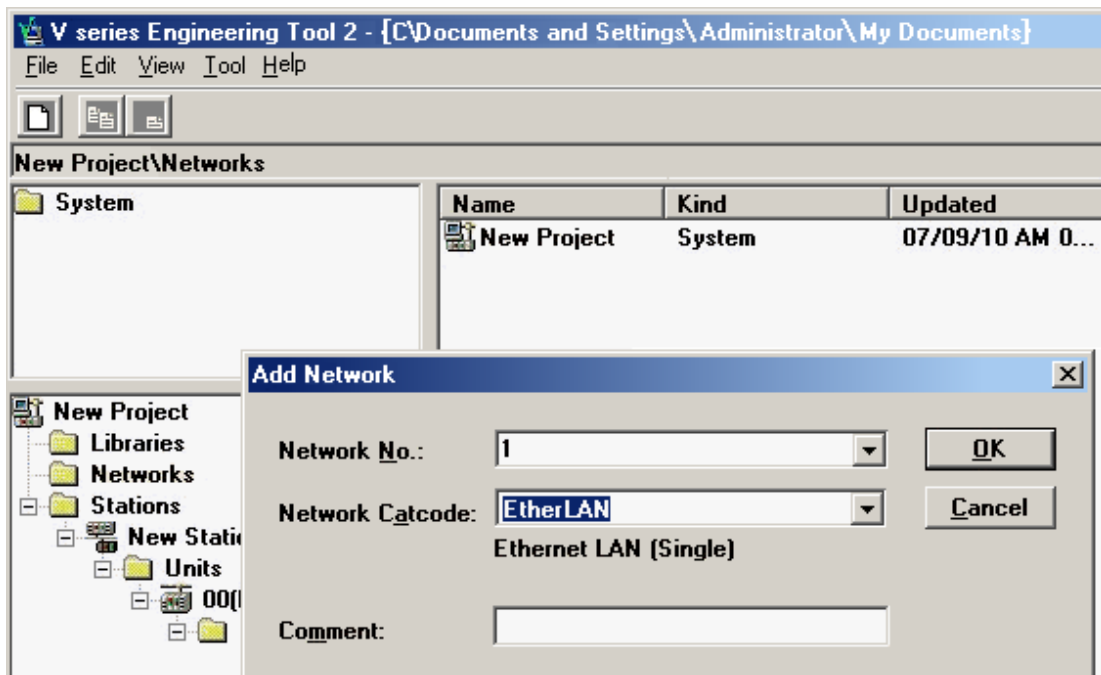


14. Right-click on **Module** and select **New**. Select the Ethernet module and then close the window.

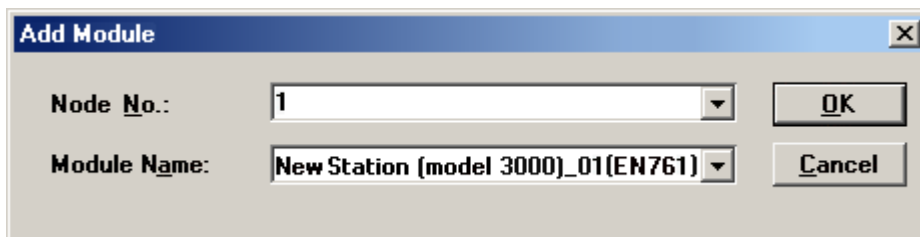

15. To verify that connections have been set up successfully, right-click the first subgroup under the **Stations** folder. For example, test (model 3000) and select "System View" from the list. This will show the status of the devices.

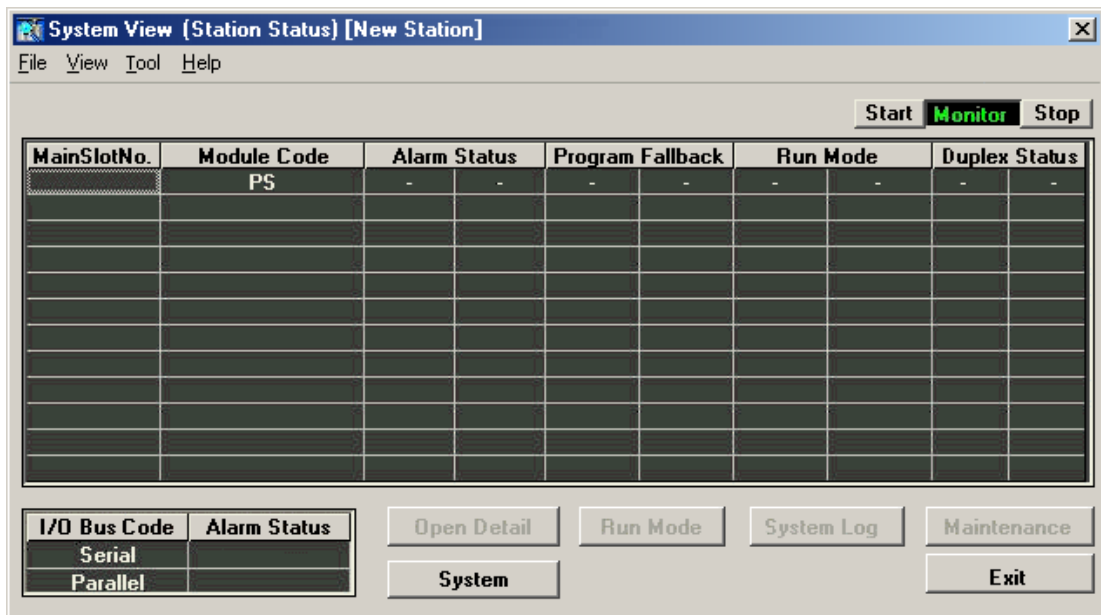


- From the **Tool** drop-down list, select **Com. Para. Settings**. In the IP address box at the bottom of the window, enter the PC's IP. Then, choose Ethernet as the form of communications and close the window.

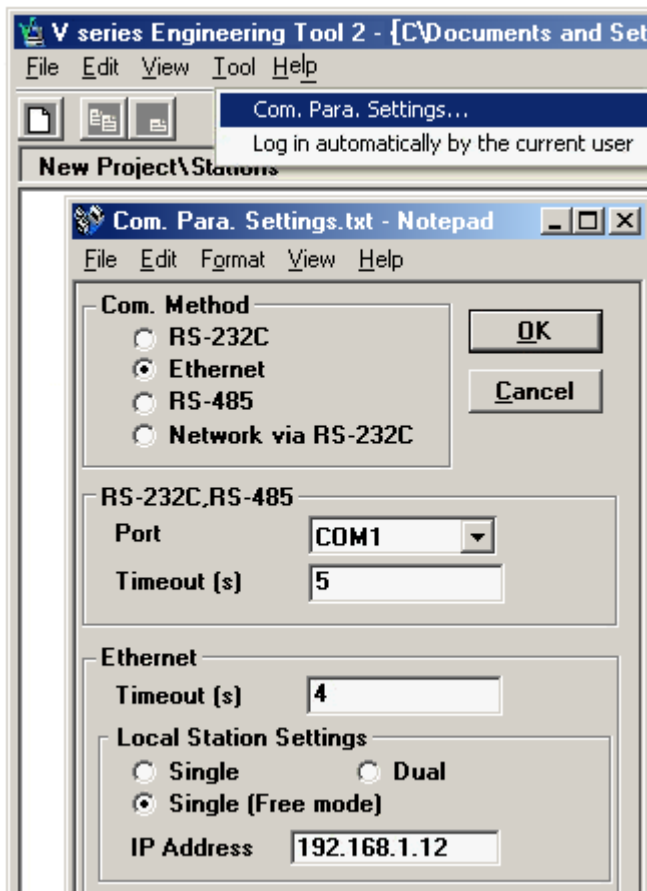

- To test the connection, return to the System View and verify that the devices' statuses are visible without any communication errors.

T2 and T3 Setup

Before this driver can be used, the PLC must be configured with an IP and port number. This can be done using a simple ladder program, which must be run each time the PLC is powered up. An example program that sets IP = 192.168.111.126 and port = 1024 is shown below. Users may wish to modify this program to run automatically whenever the PLC powers up.

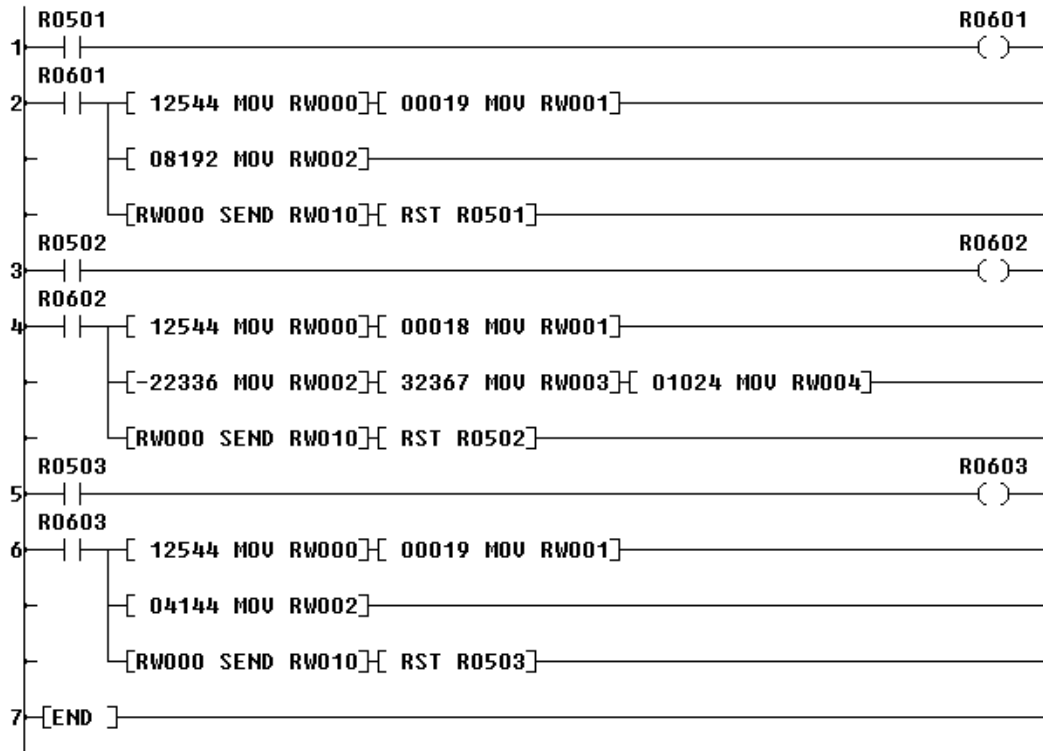

The first block of code at rung 2 places the PLC in Standby Mode when bit R0501 is set. This must be done before the IP and port can be set. The second block of code at rung 4 sets the IP and port number when bit R0502 is set. The final block of code at rung 6 puts the PLC back in Run Mode when bit R0603 is set.

Each block of code places parameters in memory starting at RW000, issues a SEND command using those parameters, and then resets the corresponding trigger bit. The parameters in each block are defined as shown in the tables below.

Set Standby Mode

Parameter	Value	Description
RW000	0x3100 (12544)	Specifies module
RW001	0x0013 (19)	Change mode command code
RW002	0x2000 (8192)	Specifies standby mode

Set IP and Port

Parameter	Value	Description
RW000	0x3100 (12544)	Specifies module
RW001	0x0012 (18)	Set IP and port command code
RW002	User Defined	Specifies upper 2 octals of IP address (network byte order)
RW003	User Defined	Specifies lower 2 octals of IP address (network byte order)
RW004	User Defined	Specifies port number

The IP address parameters must be in the correct format. In the example IP, the four octals that follow are expressed in hex: 0xC0 (192), 0xA8 (168), 0x6F (111) and 0x7E (126). Therefore, the value placed in RW002 is 0xA8C0 (or -22336 as a signed integer). The value placed in RW003 is 0x7E6F (or 32367 as a signed integer).

Set Run Mode

Parameter	Value	Description
RW000	0x3100 (12544)	Specifies module
RW001	0x0013 (19)	Change mode command code
RW002	0x1030 (4144)	Specifies Run Mode

Index

A

Address <address> is out of range for the specified device or register 22

Address Descriptions 16

Attempts Before Timeout 12

Auto-Demotion 12

B

Boolean 15

C

Channel Assignment 9

Channel Properties — Advanced 8

Channel Properties — Ethernet Communications 7

Channel Properties — General 6

Channel Properties — Write Optimizations 7

Communications Parameters 13

Communications Timeouts 11

Connect Timeout 12

D

Data Collection 10

Data Type <type> is not valid for device address <address> 22

Data Types Description 15

Deactivating tag block. Bad address in block [<start address> to <end address>] on device <device name> 23

Demote on Failure 13

Demotion Period 13

Device <device name> responded with error code n Tag <tag name> 24

Device <device name> not responding 24

Device address <address> contains a syntax error 22

Device address <address> is not supported by model <model name>.' 23

Device address <address> is Read Only 23

Device ID 4
Device Properties — Auto-Demotion 12
Device Properties — General 9
Device Properties — Redundancy 13
Device Properties — Timing 11
Diagnostics 6
Discard Requests when Demoted 13
Do Not Scan, Demand Poll Only 11
Driver 9
Duty Cycle 8
DWord 15

E

Error Descriptions 22
Ethernet Settings 7

G

General 9

H

Hardware Configuration 26
Help Contents 4

I

ID 10
Identification 6, 9
Initial Updates from Cache 11
Inter-Device Delay 9

L

Long 15

M

Missing address 23

Model 9

N

Name 9

Network Adapter 7

Non-Normalized Float Handling 8

O

Operating Mode 10

Optimization Method 7

Optimizing Communications 14

Overview 4

P

Port 13

Protocol 4

R

Redundancy 13

Replace with Zero 8

Request Timeout 12

Respect Tag-Specified Scan Rate 11

S

S Series Setup 26

S2 Addressing 19

S3 Addressing 20

Scan Mode 11

Setup 4

Short 15

Simulated 10

T

T2 Addressing 16

T2 and T3 Setup 31

T3 Addressing 17

Tag Counts 7, 10

Timeouts to Demote 13

Timing 11

U

Unable to write to address <address> on device <device name>.' 24

Unmodified 8

W

Winsock initialization failed OS Error = n 25

Winsock V1.1 or higher must be installed to use the Toshiba Ethernet device driver 25

Word 15

Write All Values for All Tags 7

Write Only Latest Value for All Tags 8

Write Only Latest Value for Non-Boolean Tags 8