

# Toshiba Serial Driver

© 2024 PTC Inc. All Rights Reserved.

# Table of Contents

<b>Toshiba Serial Driver</b> .....	<b>1</b>
<b>Table of Contents</b> .....	<b>2</b>
Toshiba Serial Driver .....	4
Overview .....	4
<b>Setup</b> .....	<b>4</b>
Channel Properties — General .....	6
Tag Counts .....	7
Channel Properties — Serial Communications .....	7
Channel Properties — Write Optimizations .....	9
Channel Properties — Advanced .....	10
Device Properties — General .....	11
Operating Mode .....	12
Tag Counts .....	12
Device Properties — Scan Mode .....	13
Device Properties — Timing .....	13
Device Properties — Auto-Demotion .....	14
Device Properties — Redundancy .....	15
<b>Data Types Description</b> .....	<b>16</b>
<b>Address Descriptions</b> .....	<b>17</b>
EX100 Addressing .....	17
EX200 Addressing .....	18
EX500 Addressing .....	19
T1, T1 Super Addressing .....	20
T2 Addressing .....	21
T3, T3H Addressing .....	22
<b>Error Descriptions</b> .....	<b>25</b>
Missing address .....	25
Device address '<address>' contains a syntax error .....	25
Address '<address>' is out of range for the specified device or register .....	25
Data Type '<type>' is not valid for device address '<address>' .....	26
Device address '<address>' is not supported by model '<model name>' .....	26
Device address '<address>' is Read Only .....	26
COMn does not exist .....	26
Error opening COMn .....	27
COMn is in use by another application .....	27
Unable to set comm properties on COMn .....	27

Communications error on '<channel name>' [<error mask>] .....	27
Device '<device name>' is not responding .....	28
Unable to write to address '<address>' on device '<device name>' .....	28
<b>Index</b> .....	<b>29</b>

---

## Toshiba Serial Driver

---

Help version 1.024

### CONTENTS

#### Overview

What is the Toshiba Serial Driver?

#### Setup

How do I configure a specific device to work with this driver?

#### Data Types Description

What data types does this driver support?

#### Address Descriptions

How do I address a data location on a Toshiba device?

#### Error Descriptions

What error messages does the Toshiba Serial Driver produce?

### Overview

---

The Toshiba Serial Driver provides a reliable way to connect Toshiba Serial devices to OPC Client applications, including HMI, SCADA, Historian, MES, ERP, and countless custom applications. It uses the Toshiba ASCII Computer Link protocol to communicate with the PLC. Before attempting to use the driver in an OPC server software project, users should understand the different data types and the addressing scheme.

• For more information, refer to [Data Types Description](#) and [Address Descriptions](#).

### Setup

---

#### Supported Devices

EX100  
EX200  
T1  
T1 Super  
T2 PLCs  
T3 PLCs

#### Communication Protocol

Toshiba ASCII Computer Link Protocol

#### Supported Communication Parameters

Baud Rate: 1200, 2400, 9600, 19200, or 38400  
Parity: None, Even, or Odd  
Data Bits: 5, 6, 7 or 8  
Stop Bits: 1 or 2

#### Channel and Device Limits

The maximum number of channels supported by this driver is 100. The maximum number of devices supported by this driver is 16 per channel.

### Device IDs

EX100: Up to 16 devices numbered from 0 to 15.

EX200: Up to 10 devices numbered from 0 to 9.

T1 and T2: Up to 32 devices numbered from 1 to 32.

T3 and T3H: Up to 64 devices numbered from 1 to 64.

### Flow Control

When using an RS232 / RS485 converter, the type of flow control that is required depends on the needs of the converter. Some converters do not require any flow control whereas others require RTS flow. Consult the converter's documentation to determine its flow requirements. An RS485 converter that provides automatic flow control is recommended.

● **Note:** When using T1 devices, **RTS Always** should be specified.

### Ethernet Encapsulation

This driver supports Ethernet Encapsulation, which allows the driver to communicate with serial devices attached to an Ethernet network using a terminal server or device server. It may be invoked through the COM ID dialog in [Channel Properties](#).

### Cable Connections

The T1 can be directly connected to the PC COM port using RS232 communications. The EX100, EX200 and T2 can be linked to the PC's RS232 interface through a RS232/RS422 converter. For connection information between the PLC and a RS232/RS422 converter, refer to the PLC manual.

## Channel Properties — General

This server supports the use of multiple simultaneous communications drivers. Each protocol or driver used in a server project is called a channel. A server project may consist of many channels with the same communications driver or with unique communications drivers. A channel acts as the basic building block of an OPC link. This group is used to specify general channel properties, such as the identification attributes and operating mode.

Property Groups <b>General</b> Write Optimizations Advanced	<table border="1"> <tr> <td colspan="2"><b>Identification</b></td> </tr> <tr> <td>Name</td> <td></td> </tr> <tr> <td>Description</td> <td></td> </tr> <tr> <td>Driver</td> <td></td> </tr> <tr> <td colspan="2"><b>Diagnostics</b></td> </tr> <tr> <td>Diagnostics Capture</td> <td>Disable</td> </tr> <tr> <td colspan="2"><b>Tag Counts</b></td> </tr> <tr> <td>Static Tags</td> <td>10</td> </tr> </table>	<b>Identification</b>		Name		Description		Driver		<b>Diagnostics</b>		Diagnostics Capture	Disable	<b>Tag Counts</b>		Static Tags	10
<b>Identification</b>																	
Name																	
Description																	
Driver																	
<b>Diagnostics</b>																	
Diagnostics Capture	Disable																
<b>Tag Counts</b>																	
Static Tags	10																

### Identification

**Name:** Specify the user-defined identity of this channel. In each server project, each channel name must be unique. Although names can be up to 256 characters, some client applications have a limited display window when browsing the OPC server's tag space. The channel name is part of the OPC browser information. The property is required for creating a channel.

● For information on reserved characters, refer to "How To... Properly Name a Channel, Device, Tag, and Tag Group" in the server help.

**Description:** Specify user-defined information about this channel.

● Many of these properties, including Description, have an associated system tag.

**Driver:** Specify the protocol / driver for this channel. Specify the device driver that was selected during channel creation. It is a disabled setting in the channel properties. The property is required for creating a channel.

● **Note:** With the server's online full-time operation, these properties can be changed at any time. This includes changing the channel name to prevent clients from registering data with the server. If a client has already acquired an item from the server before the channel name is changed, the items are unaffected. If, after the channel name has been changed, the client application releases the item and attempts to re-acquire using the old channel name, the item is not accepted. Changes to the properties should not be made once a large client application has been developed. Utilize proper user role and privilege management to prevent operators from changing properties or accessing server features.

### Diagnostics

**Diagnostics Capture:** When enabled, this option makes the channel's diagnostic information available to OPC applications. Because the server's diagnostic features require a minimal amount of overhead processing, it is recommended that they be utilized when needed and disabled when not. The default is disabled.

● **Note:** This property is not available if the driver does not support diagnostics.

● For more information, refer to *Communication Diagnostics in the server help*.

### Diagnostics

**Diagnostics Capture:** When enabled, this option allows the usage of statistics tags that provide feedback to client applications regarding the operation of the channel. Because the server's diagnostic features require a minimal amount of overhead processing, it is recommended that they be utilized when needed and disabled when not. The default is disabled.

● **Note:** This property is not available if the driver does not support diagnostics.

● *For more information, refer to Statistics Tags in the server help.*

## Tag Counts

**Static Tags:** Provides the total number of defined static tags at this level (device or channel). This information can be helpful in troubleshooting and load balancing.

## Channel Properties — Serial Communications

Serial communication properties are available to serial drivers and vary depending on the driver, connection type, and options selected. Below is a superset of the possible properties.

Click to jump to one of the sections: [Connection Type](#), [Serial Port Settings](#), and [Operational Behavior](#).

### Notes:

- With the server's online full-time operation, these properties can be changed at any time. Utilize proper user role and privilege management to prevent operators from changing properties or accessing server features.
- Users must define the specific communication parameters to be used. Depending on the driver, channels may or may not be able to share identical communication parameters. Only one shared serial connection can be configured for a Virtual Network (see [Channel Properties — Serial Communications](#)).

Property Groups		
General		
<b>Serial Communications</b>		
Write Optimizations		
Advanced		
	<b>Connection Type</b>	
	Physical Medium	COM Port
	<b>Serial Port Settings</b>	
	COM ID	39
	Baud Rate	19200
	Data Bits	8
	Parity	None
	Stop Bits	1
	Flow Control	RTS Always
	<b>Operational Behavior</b>	
	Report Communication Errors	Enable
	Close Idle Connection	Enable
	Idle Time to Close (s)	15

## Connection Type

**Physical Medium:** Choose the type of hardware device for data communications. Options include Modem, COM Port, and None. The default is COM Port.

1. **None:** Select None to indicate there is no physical connection, which displays the [Operation with no Communications](#) section.
2. **COM Port:** Select Com Port to display and configure the [Serial Port Settings](#) section.

3. **Modem:** Select Modem if phone lines are used for communications, which are configured in the [Modem Settings](#) section.
4. **Shared:** Verify the connection is correctly identified as sharing the current configuration with another channel. This is a read-only property.

## Serial Port Settings

**COM ID:** Specify the Communications ID to be used when communicating with devices assigned to the channel. The valid range is 1 to 9991 to 16. The default is 1.

**Baud Rate:** Specify the baud rate to be used to configure the selected communications port.

**Data Bits:** Specify the number of data bits per data word. Options include 5, 6, 7, or 8.

**Parity:** Specify the type of parity for the data. Options include Odd, Even, or None.


**Stop Bits:** Specify the number of stop bits per data word. Options include 1 or 2.

**Flow Control:** Select how the RTS and DTR control lines are utilized. Flow control is required to communicate with some serial devices. Options are:

- **None:** This option does not toggle or assert control lines.
- **DTR:** This option asserts the DTR line when the communications port is opened and remains on.
- **RTS:** This option specifies that the RTS line is high if bytes are available for transmission. After all buffered bytes have been sent, the RTS line is low. This is normally used with RS232/RS485 converter hardware.
- **RTS, DTR:** This option is a combination of DTR and RTS.
- **RTS Always:** This option asserts the RTS line when the communication port is opened and remains on.
- **RTS Manual:** This option asserts the RTS line based on the timing properties entered for RTS Line Control. It is only available when the driver supports manual RTS line control (or when the properties are shared and at least one of the channels belongs to a driver that provides this support).

RTS Manual adds an **RTS Line Control** property with options as follows:

- **Raise:** Specify the amount of time that the RTS line is raised prior to data transmission. The valid range is 0 to 9999 milliseconds. The default is 10 milliseconds.
- **Drop:** Specify the amount of time that the RTS line remains high after data transmission. The valid range is 0 to 9999 milliseconds. The default is 10 milliseconds.
- **Poll Delay:** Specify the amount of time that polling for communications is delayed. The valid range is 0 to 9999. The default is 10 milliseconds.

 **Tip:** When using two-wire RS-485, "echoes" may occur on the communication lines. Since this communication does not support echo suppression, it is recommended that echoes be disabled or a RS-485 converter be used.

## Operational Behavior

- **Report Communication Errors:** Enable or disable reporting of low-level communications errors. When enabled, low-level errors are posted to the Event Log as they occur. When disabled, these same errors are not posted even though normal request failures are. The default is Enable.



- **Close Idle Connection:** Choose to close the connection when there are no longer any tags being referenced by a client on the channel. The default is Enable.
- **Idle Time to Close:** Specify the amount of time that the server waits once all tags have been removed before closing the COM port. The default is 15 seconds.

## Modem Settings

- **Modem:** Specify the installed modem to be used for communications.
- **Connect Timeout:** Specify the amount of time to wait for connections to be established before failing a read or write. The default is 60 seconds.
- **Modem Properties:** Configure the modem hardware. When clicked, it opens vendor-specific modem properties.
- **Auto-Dial:** Enables the automatic dialing of entries in the Phonebook. The default is Disable. *For more information, refer to "Modem Auto-Dial" in the server help.*
- **Report Communication Errors:** Enable or disable reporting of low-level communications errors. When enabled, low-level errors are posted to the Event Log as they occur. When disabled, these same errors are not posted even though normal request failures are. The default is Enable.
- **Close Idle Connection:** Choose to close the modem connection when there are no longer any tags being referenced by a client on the channel. The default is Enable.
- **Idle Time to Close:** Specify the amount of time that the server waits once all tags have been removed before closing the modem connection. The default is 15 seconds.

## Operation with no Communications

- **Read Processing:** Select the action to be taken when an explicit device read is requested. Options include Ignore and Fail. Ignore does nothing; Fail provides the client with an update that indicates failure. The default setting is Ignore.

## Channel Properties — Write Optimizations

The server must ensure that the data written from the client application gets to the device on time. Given this goal, the server provides optimization properties to meet specific needs or improve application responsiveness.

Property Groups	[-] <b>Write Optimizations</b>	
General	Optimization Method	Write Only Latest Value for All Tags
<b>Write Optimizations</b>	Duty Cycle	10

## Write Optimizations

**Optimization Method:** Controls how write data is passed to the underlying communications driver. The options are:

- **Write All Values for All Tags:** This option forces the server to attempt to write every value to the controller. In this mode, the server continues to gather write requests and add them to the server's internal write queue. The server processes the write queue and attempts to empty it by writing data to the device as quickly as possible. This mode ensures that everything written from the client applications is sent to the target device. This mode should be selected if the write operation order or the write item's content must uniquely be seen at the target device.

- **Write Only Latest Value for Non-Boolean Tags:** Many consecutive writes to the same value can accumulate in the write queue due to the time required to actually send the data to the device. If the server updates a write value that has already been placed in the write queue, far fewer writes are needed to reach the same final output value. In this way, no extra writes accumulate in the server's queue. When the user stops moving the slide switch, the value in the device is at the correct value at virtually the same time. As the mode states, any value that is not a Boolean value is updated in the server's internal write queue and sent to the device at the next possible opportunity. This can greatly improve the application performance.
  - **Note:** This option does not attempt to optimize writes to Boolean values. It allows users to optimize the operation of HMI data without causing problems with Boolean operations, such as a momentary push button.
- **Write Only Latest Value for All Tags:** This option takes the theory behind the second optimization mode and applies it to all tags. It is especially useful if the application only needs to send the latest value to the device. This mode optimizes all writes by updating the tags currently in the write queue before they are sent. This is the default mode.

**Duty Cycle:** is used to control the ratio of write to read operations. The ratio is always based on one read for every one to ten writes. The duty cycle is set to ten by default, meaning that ten writes occur for each read operation. Although the application is performing a large number of continuous writes, it must be ensured that read data is still given time to process. A setting of one results in one read operation for every write operation. If there are no write operations to perform, reads are processed continuously. This allows optimization for applications with continuous writes versus a more balanced back and forth data flow.

● **Note:** It is recommended that the application be characterized for compatibility with the write optimization enhancements before being used in a production environment.

## Channel Properties — Advanced

This group is used to specify advanced channel properties. Not all drivers support all properties; so the Advanced group does not appear for those devices.

Property Groups	<input type="checkbox"/> <b>Non-Normalized Float Handling</b>	
General	Floating-Point Values	Replace with Zero
Write Optimizations	<input type="checkbox"/> <b>Inter-Device Delay</b>	
<b>Advanced</b>	Inter-Device Delay (ms)	0

**Non-Normalized Float Handling:** A non-normalized value is defined as Infinity, Not-a-Number (NaN), or as a Denormalized Number. The default is Replace with Zero. Drivers that have native float handling may default to Unmodified. Non-normalized float handling allows users to specify how a driver handles non-normalized IEEE-754 floating point data. Descriptions of the options are as follows:

- **Replace with Zero:** This option allows a driver to replace non-normalized IEEE-754 floating point values with zero before being transferred to clients.
- **Unmodified:** This option allows a driver to transfer IEEE-754 denormalized, normalized, non-number, and infinity values to clients without any conversion or changes.

● **Note:** This property is disabled if the driver does not support floating-point values or if it only supports the option that is displayed. According to the channel's float normalization setting, only real-time driver tags (such as values and arrays) are subject to float normalization. For example, EFM data is not affected by this setting.

For more information on the floating-point values, refer to "How To ... Work with Non-Normalized Floating-Point Values" in the server help.

**Inter-Device Delay:** Specify the amount of time the communications channel waits to send new requests to the next device after data is received from the current device on the same channel. Zero (0) disables the delay.

**Note:** This property is not available for all drivers, models, and dependent settings.

## Device Properties — General

A device represents a single target on a communications channel. If the driver supports multiple controllers, users must enter a device ID for each controller.

Property Groups	Identification	
General	Name	
Scan Mode	Description	
	Channel Assignment	
	Driver	
	Model	
	ID Format	Decimal
	ID	2

### Identification

**Name:** Specify the name of the device. It is a logical user-defined name that can be up to 256 characters long and may be used on multiple channels.

**Note:** Although descriptive names are generally a good idea, some OPC client applications may have a limited display window when browsing the OPC server's tag space. The device name and channel name become part of the browse tree information as well. Within an OPC client, the combination of channel name and device name would appear as "ChannelName.DeviceName".

For more information, refer to "How To... Properly Name a Channel, Device, Tag, and Tag Group" in server help.

**Description:** Specify the user-defined information about this device.

Many of these properties, including Description, have an associated system tag.

**Channel Assignment:** Specify the user-defined name of the channel to which this device currently belongs.

**Driver:** Selected protocol driver for this device.

**Model:** Specify the type of device that is associated with this ID. The contents of the drop-down menu depend on the type of communications driver being used. Models that are not supported by a driver are disabled. If the communications driver supports multiple device models, the model selection can only be changed when there are no client applications connected to the device.

**Note:** If the communication driver supports multiple models, users should try to match the model selection to the physical device. If the device is not represented in the drop-down menu, select a model that conforms closest to the target device. Some drivers support a model selection called "Open," which allows users to communicate without knowing the specific details of the target device. For more information, refer to the driver documentation.

**ID:** Specify the device's driver-specific station or node. The type of ID entered depends on the communications driver being used. For many communication drivers, the ID is a numeric value. Drivers that support a Numeric ID provide users with the option to enter a numeric value whose format can be changed to suit the needs of the application or the characteristics of the selected communications driver. The format is set by the driver by default. Options include Decimal, Octal, and Hexadecimal.

## Operating Mode

Property Groups	+ Identification	
General	- Operating Mode	
Scan Mode	Data Collection	Enable
	Simulated	No

**Data Collection:** This property controls the device's active state. Although device communications are enabled by default, this property can be used to disable a physical device. Communications are not attempted when a device is disabled. From a client standpoint, the data is marked as invalid and write operations are not accepted. This property can be changed at any time through this property or the device system tags.

**Simulated:** Place the device into or out of Simulation Mode. In this mode, the driver does not attempt to communicate with the physical device, but the server continues to return valid OPC data. Simulated stops physical communications with the device, but allows OPC data to be returned to the OPC client as valid data. While in Simulation Mode, the server treats all device data as reflective: whatever is written to the simulated device is read back and each OPC item is treated individually. The data is not saved if the server removes the item (such as when the server is reinitialized). The default is No.

### Notes:

1. Updates are not applied until clients disconnect and reconnect.
2. The System tag (\_Simulated) is read only and cannot be written to for runtime protection. The System tag allows this property to be monitored from the client.
3. In Simulation mode, the item's memory map is based on client update rate(s) (Group Update Rate for OPC clients or Scan Rate for native and DDE interfaces). This means that two clients that reference the same item with different update rates return different data.
4. When a device is simulated, updates may not appear faster than one (1) second in the client.

Simulation Mode is for test and simulation purposes only. It should never be used in a production environment.

## Tag Counts

Property Groups	- Identification	
General	- Operating Mode	
	- Tag Counts	
	Static Tags	130

**Static Tags:** Provides the total number of defined static tags at this level (device or channel). This information can be helpful in troubleshooting and load balancing.

## Device Properties — Scan Mode

The Scan Mode specifies the subscribed-client requested scan rate for tags that require device communications. Synchronous and asynchronous device reads and writes are processed as soon as possible; unaffected by the Scan Mode properties.

Property Groups	<input type="checkbox"/> <b>Scan Mode</b>	
General	Scan Mode	Respect Client-Specified Scan Rate ▾
<b>Scan Mode</b>	Initial Updates from Cache	Disable

**Scan Mode:** Specify how tags in the device are scanned for updates sent to subscribing clients. Descriptions of the options are:

- **Respect Client-Specified Scan Rate:** This mode uses the scan rate requested by the client.
- **Request Data No Faster than Scan Rate:** This mode specifies the value set as the maximum scan rate. The valid range is 10 to 99999990 milliseconds. The default is 1000 milliseconds.
  - **Note:** When the server has an active client and items for the device and the scan rate value is increased, the changes take effect immediately. When the scan rate value is decreased, the changes do not take effect until all client applications have been disconnected.
- **Request All Data at Scan Rate:** This mode forces tags to be scanned at the specified rate for subscribed clients. The valid range is 10 to 99999990 milliseconds. The default is 1000 milliseconds.
- **Do Not Scan, Demand Poll Only:** This mode does not periodically poll tags that belong to the device nor perform a read to get an item's initial value once it becomes active. It is the OPC client's responsibility to poll for updates, either by writing to the `_DemandPoll` tag or by issuing explicit device reads for individual items. *For more information, refer to "Device Demand Poll" in server help.*
- **Respect Tag-Specified Scan Rate:** This mode forces static tags to be scanned at the rate specified in their static configuration tag properties. Dynamic tags are scanned at the client-specified scan rate.

**Initial Updates from Cache:** When enabled, this option allows the server to provide the first updates for newly activated tag references from stored (cached) data. Cache updates can only be provided when the new item reference shares the same address, scan rate, data type, client access, and scaling properties. A device read is used for the initial update for the first client reference only. The default is disabled; any time a client activates a tag reference the server attempts to read the initial value from the device.

## Device Properties — Timing

The device Timing properties allow the driver's response to error conditions to be tailored to fit the application's needs. In many cases, the environment requires changes to these properties for optimum performance. Factors such as electrically generated noise, modem delays, and poor physical connections can influence how many errors or timeouts a communications driver encounters. Timing properties are specific to each configured device.

Property Groups	<input type="checkbox"/> <b>Communication Timeouts</b>	
General	Connect Timeout (s)	3
Scan Mode	Request Timeout (ms)	1000
<b>Timing</b>	Attempts Before Timeout	3

### Communications Timeouts

**Connect Timeout:** This property (which is used primarily by Ethernet based drivers) controls the amount of time required to establish a socket connection to a remote device. The device's connection time often takes longer than normal communications requests to that same device. The valid range is 1 to 30 seconds. The default is typically 3 seconds, but can vary depending on the driver's specific nature. If this setting is not supported by the driver, it is disabled.

● **Note:** Due to the nature of UDP connections, the connection timeout setting is not applicable when communicating via UDP.


**Request Timeout:** Specify an interval used by all drivers to determine how long the driver waits for a response from the target device to complete. The valid range is 50 to 9999999 milliseconds (167 minutes). The default is usually 1000 milliseconds, but can vary depending on the driver. The default timeout for most serial drivers is based on a baud rate of 9600 baud or better. When using a driver at lower baud rates, increase the timeout to compensate for the increased time required to acquire data.

**Attempts Before Timeout:** Specify how many times the driver issues a communications request before considering the request to have failed and the device to be in error. The valid range is 1 to 10. The default is typically 3, but can vary depending on the driver's specific nature. The number of attempts configured for an application depends largely on the communications environment. This property applies to both connection attempts and request attempts.

## Timing

**Inter-Request Delay:** Specify how long the driver waits before sending the next request to the target device. It overrides the normal polling frequency of tags associated with the device, as well as one-time reads and writes. This delay can be useful when dealing with devices with slow turnaround times and in cases where network load is a concern. Configuring a delay for a device affects communications with all other devices on the channel. It is recommended that users separate any device that requires an inter-request delay to a separate channel if possible. Other communications properties (such as communication serialization) can extend this delay. The valid range is 0 to 300,000 milliseconds; however, some drivers may limit the maximum value due to a function of their particular design. The default is 0, which indicates no delay between requests with the target device.

● **Note:** Not all drivers support Inter-Request Delay. This setting does not appear if it is not available.

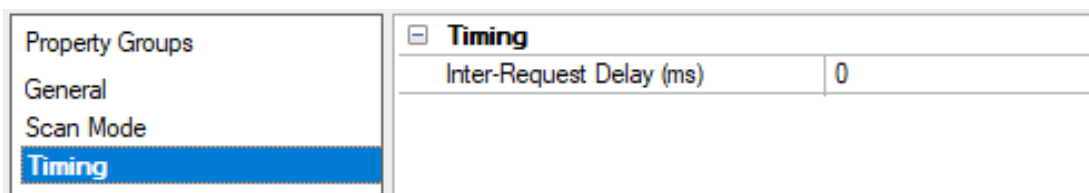


## Device Properties — Auto-Demotion

The Auto-Demotion properties can temporarily place a device off-scan in the event that a device is not responding. By placing a non-responsive device offline for a specific time period, the driver can continue to optimize its communications with other devices on the same channel. After the time period has been reached, the driver re-attempts to communicate with the non-responsive device. If the device is responsive, the device is placed on-scan; otherwise, it restarts its off-scan time period.

Property Groups	<input type="checkbox"/> <b>Auto-Demotion</b>	
General	Demote on Failure	Enable
Scan Mode	Timeouts to Demote	3
Timing	Demotion Period (ms)	10000
<b>Auto-Demotion</b>	Discard Requests when Demoted	Disable

**Demote on Failure:** When enabled, the device is automatically taken off-scan until it is responding again.

 **Tip:** Determine when a device is off-scan by monitoring its demoted state using the `_AutoDemoted` system tag.

**Timeouts to Demote:** Specify how many successive cycles of request timeouts and retries occur before the device is placed off-scan. The valid range is 1 to 30 successive failures. The default is 3.


**Demotion Period:** Indicate how long the device should be placed off-scan when the timeouts value is reached. During this period, no read requests are sent to the device and all data associated with the read requests are set to bad quality. When this period expires, the driver places the device on-scan and allows for another attempt at communications. The valid range is 100 to 3600000 milliseconds. The default is 10000 milliseconds.

**Discard Requests when Demoted:** Select whether or not write requests should be attempted during the off-scan period. Disable to always send write requests regardless of the demotion period. Enable to discard writes; the server automatically fails any write request received from a client and does not post a message to the Event Log.

## Device Properties — Redundancy

Property Groups	<input type="checkbox"/> <b>Redundancy</b>	
General	Secondary Path	Channel.Device 1 ...
Scan Mode	Operating Mode	Switch On Failure
Timing	Monitor Item	
Auto-Demotion	Monitor Interval (s)	300
Tag Generation	Return to Primary ASAP	Yes
Tag Import Settings		
<b>Redundancy</b>		

Redundancy is available with the Media-Level Redundancy Plug-In.

 Consult the website, a sales representative, or the [user manual](#) for more information.

## Data Types Description

Data Type	Description
Boolean	Single bit
Word	Unsigned 16-bit value bit 0 is the least significant bit bit 15 the most significant bit
Short	Signed 16-bit value bit 0 is the least significant bit bit 14 the most significant bit bit 15 is the sign bit
DWord	Unsigned 32-bit value bit 0 is the least significant bit bit 31 the most significant bit
Long	Signed 32-bit value bit 0 is the least significant bit bit 30 the most significant bit bit 31 is the sign bit
Float	32-bit floating point value. The driver interprets two consecutive registers as a floating point value by making the second register the high word and the first register the low word.
String	Null-terminated ASCII string This is supported on all models and includes HiLo LoHi byte order selection.



## Address Descriptions

Address specifications vary depending on the model in use. Select a link from the following list to obtain specific address information for the model of interest.

[EX100](#)

[EX200](#)

[EX500](#)

[T1, T1Super](#)

[T2](#)

[T3, T3H](#)

## EX100 Addressing

The default data types are shown in **bold**.

Address Type	Range	Data Type	Access
Input Devices	X00...X0F-X310...X31F	Boolean	Read/Write
Output Devices	Y00...Y0F-Y310...Y31F	Boolean	Read/Write
Input Registers	XW0-XW63	<b>Word</b> , Short	Read/Write
	XW0-XW62	DWord, Long, Float	
Output Registers	YW0-YW63	<b>Word</b> , Short	Read/Write
	YW0-YW62	DWord, Long, Float	
Auxiliary Devices	R00...R0F-R630...R63F	Boolean	Read/Write
Auxiliary Registers	RW0-RW63	<b>Word</b> , Short	Read/Write
	RW0-RW62	DWord, Long, Float	
Link Register Relays	Z00...Z0F-Z310...Z31F	Boolean	Read/Write
Link Registers	ZW0-ZW31	<b>Word</b> , Short	Read/Write
	ZW0-ZW30	DWord, Long, Float	
Counter Registers	C0-C95	<b>Word</b> , Short	Read/Write
Timer Registers	T0-T127	<b>Word</b> , Short	Read/Write
Data Memory	D0-D1535	<b>Word</b> , Short	Read/Write
	D0-D1534	DWord, Long, Float	
Data Memory As String with HiLo Byte Order	D0.2H-D1535.64H .Bit is string length, range 2 to 64 bytes.	<b>String</b>	Read/Write
Data Memory As String with LoHi Byte Order	D0.2L-D1535.64L .Bit is string length, range 2 to 64 bytes.	<b>String</b>	Read/Write

## String Support

The Toshiba Serial Driver supports reading and writing Data registers as an ASCII string. When using Data registers for string data, each register will contain two bytes of ASCII data. The order of the ASCII data within

a given register can be selected when the string is defined. The length of the string can be from 2 to 64 bytes and is entered in place of a bit number. The length must be entered as an even number. The byte order is specified by appending either a "H" or "L" to the address.

### Examples

1. To address a string starting at D200 with a length of 50 bytes and HiLo byte order, enter: D200.50H
2. To address a string starting at D500 with a length of 38 bytes and LoHi byte order, enter: D500.38L

## EX200 Addressing

The default data types are shown in **bold**.

Address Type	Range	Data Type	Access
Input Devices	X00...X0F-X310...X31F	Boolean	Read/Write
Output Devices	Y00...Y0F-Y310...Y31F	Boolean	Read/Write
Input Registers	XW0-XW63	<b>Word</b> , Short	Read/Write
	XW0-XW62	DWord, Long, Float	
Output Registers	YW0-YW63	<b>Word</b> , Short	Read/Write
	YW0-YW62	DWord, Long, Float	
Auxiliary Devices	R00...R0F-R630...R63F	Boolean	Read/Write
Auxiliary Registers	RW0-RW63	<b>Word</b> , Short	Read/Write
	RW0-RW62	DWord, Long, Float	
Link Register Relays	Z00...Z0F-Z310...Z31F	Boolean	Read/Write
Link Registers	ZW0-ZW31	<b>Word</b> , Short	Read/Write
	ZW0-ZW30	DWord, Long, Float	
Counter Registers	C0-C95	<b>Word</b> , Short	Read/Write
Timer Registers	T0-T127	<b>Word</b> , Short	Read/Write
Data Memory	D0-D1535	<b>Word</b> , Short	Read/Write
	D0-D1534	DWord, Long, Float	
Data Memory As String with HiLo Byte Order	D0.2H-D1535.64H .Bit is string length, range 2 to 64 bytes.	<b>String</b>	Read/Write
Data Memory As String with LoHi Byte Order	D0.2L-D1535.64L .Bit is string length, range 2 to 64 bytes.	<b>String</b>	Read/Write

### String Support

The Toshiba Serial Driver supports reading and writing Data registers as an ASCII string. When using Data registers for string data, each register will contain two bytes of ASCII data. The order of the ASCII data within a given register can be selected when the string is defined. The length of the string can be from 2 to 64 bytes

and is entered in place of a bit number. The length must be entered as an even number. The byte order is specified by appending either a "H" or "L" to the address.

### Examples

1. To address a string starting at D200 with a length of 50 bytes and HiLo byte order, enter: D200.50H
2. To address a string starting at D500 with a length of 38 bytes and LoHi byte order, enter: D500.38L

## EX500 Addressing

The default data types are shown in **bold**.

Address Type	Range	Data Type	Access
Input Devices	X00...X0F-X310...X31F	Boolean	Read/Write
Output Devices	Y00...Y0F-Y310...Y31F	Boolean	Read/Write
Input Registers	XW0-XW63	<b>Word</b> , Short	Read/Write
	XW0-XW62	DWord, Long, Float	
Output Registers	YW0-YW63	<b>Word</b> , Short	Read/Write
	YW0-YW62	DWord, Long, Float	
Auxiliary Devices	R00...R0F-R630...R63F	Boolean	Read/Write
Auxiliary Registers	RW0-RW63	<b>Word</b> , Short	Read/Write
	RW0-RW62	DWord, Long, Float	
Link Register Relays	Z00...Z0F-Z310...Z31F	Boolean	Read/Write
Link Registers	ZW0-ZW31	<b>Word</b> , Short	Read/Write
	ZW0-ZW30	DWord, Long, Float	
Counter Registers	C0-C95	<b>Word</b> , Short	Read/Write
Timer Registers	T0-T127	<b>Word</b> , Short	Read/Write
Data Memory	D0-D1535	<b>Word</b> , Short	Read/Write
	D0-D1534	DWord, Long, Float	
Data Memory As String with HiLo Byte Order	D0.2H-D1535.64H .Bit is string length, range 2 to 64 bytes.	<b>String</b>	Read/Write
Data Memory As String with LoHi Byte Order	D0.2L-D1535.64L .Bit is string length, range 2 to 64 bytes.	<b>String</b>	Read/Write

### String Support

The Toshiba Serial Driver supports reading and writing Data registers as an ASCII string. When using Data registers for string data, each register will contain two bytes of ASCII data. The order of the ASCII data within a given register can be selected when the string is defined. The length of the string can be from 2 to 64 bytes and is entered in place of a bit number. The length must be entered as an even number. The byte order is specified by appending either a "H" or "L" to the address.

### Examples

1. To address a string starting at D200 with a length of 50 bytes and HiLo byte order, enter: D200.50H
2. To address a string starting at D500 with a length of 38 bytes and LoHi byte order, enter: D500.38L

## T1, T1 Super Addressing

The default data types are shown in **bold**.

Address Type	T1 Range	T1S Range	Data Type	Access
Input Devices	X000 - X31F	X000 - X31F	Boolean	Read/Write
Output Devices	Y020 - Y31F	Y020 - Y31F	Boolean	Read/Write
Input Registers	XW00-XW31	XW00-XW31	<b>Word</b> , Short, DWord, Long, Float	Read/Write
Output Registers	YW02-YW31	YW02-YW31	<b>Word</b> , Short, DWord, Long, Float	Read/Write
Auxiliary Devices	R000 - R63F	R000 - R255F	Boolean	Read/Write
Auxiliary Registers	RW00 - RW63	RW00 - RW255	<b>Word</b> , Short DWord, Long, Float	Read/Write
Special Devices	S000 - S63F	S000 - S63F	Boolean	Read/Write
Special Registers	SW00 - SW63	SW00 - SW63	<b>Word</b> , Short DWord, Long, Float	Read Only
Counter Registers	C00-C63	C000-C255	<b>Word</b> , Short	Read/Write
Counter Devices	C.00-C.63	C.00-C.255	Boolean	Read Only
Timer Registers	T00 - T63	T000 - T255	<b>Word</b> , Short	Read/Write
Timer Devices	T.00-T.63	T.000-T.255	Boolean	Read Only
Data Memory	D0-D4095 D0-D4094	D0-D4095 D0-D4094	<b>Word</b> , Short DWord, Long, Float	Read/Write
Data Memory As String with HiLo Byte Order	D0.2H-D4095.64H .Bit is string length, range 2 to 64 bytes.	D0.2H-D4095.64H .Bit is string length, range 2 to 64 bytes.	<b>String</b>	Read/Write
Data Memory As String with LoHi Byte Order	D0.2L-D4095.64L .Bit is string length, range 2 to 64 bytes.	D0.2L-D4095.64L .Bit is string length, range 2 to 64 bytes.	<b>String</b>	Read/Write

### String Support

The Toshiba Serial Driver supports reading and writing Data registers as an ASCII string. When using Data registers for string data, each register will contain two bytes of ASCII data. The order of the ASCII data within a given register can be selected when the string is defined. The length of the string can be from 2 to 64 bytes and is entered in place of a bit number. The length must be entered as an even number. The byte order is specified by appending either a "H" or "L" to the address.

### Examples

1. To address a string starting at D200 with a length of 50 bytes and HiLo byte order, enter: D200.50H
2. To address a string starting at D500 with a length of 38 bytes and LoHi byte order, enter: D500.38L

## T2 Addressing

The default data types are shown in **bold**.

Address Type	Range	Data Type	Access
Input Devices	X00...X0F-X630...X63F	Boolean	Read/Write
Direct Input Devices	I00...I0F-I630...I63F	Boolean	Read Only
Output Devices	Y00...Y0F-Y630...Y63F	Boolean	Read/Write
Direct Output Devices	O00...O0F-O630...O63F	Boolean	Read/Write
Input Registers	XW0-XW63	<b>Word</b> , Short	Read/Write
	XW0-XW62	DWord, Long, Float	
Direct Input Registers	IW0-IW63	<b>Word</b> , Short	Read/Write
	IW0-IW62	DWord, Long, Float	
Output Registers	YW0-YW63	<b>Word</b> , Short	Read/Write
	YW0-YW62	DWord, Long, Float	
Direct Output Registers	OW0-OW63	<b>Word</b> , Short	Read/Write
	OW0-OW62	DWord, Long, Float	
Link Relays	L00...L0F-L2550...L255F	Boolean	Read/Write
Link Registers	LW0-LW255	<b>Word</b> , Short	Read/Write
	LW0-LW254	DWord, Long, Float	
Link Registers	W0-W1023	<b>Word</b> , Short	Read/Write
	W0-W1022	DWord, Long, Float	
Link Register Relays	Z00...Z0F-Z5110...Z511F	Boolean	Read/Write
File Registers	F0-F1023	<b>Word</b> , Short	Read/Write
	F0-F1022	DWord, Long, Float	
Auxiliary Devices	R00...R0F-R1270...R127F	Boolean	Read/Write
Auxiliary Registers	RW0-RW127	<b>Word</b> , Short	Read/Write
	RW0-RW126	DWord, Long, Float	
Special Devices	S00...S0F-S2550...S255F	Boolean	Read/Write
Special Registers	SW0-SW255	<b>Word</b> , Short	Read Only
	SW0-SW254	DWord, Long, Float	
Counter Registers	C0-C255	<b>Word</b> , Short	Read/Write

Address Type	Range	Data Type	Access
Counter Devices	C.0-C.255	Boolean	Read Only
Timer Registers	T0-T255	<b>Word</b> , Short	Read/Write
Timer Devices	T.0-T.255	Boolean	Read Only
Data Memory	D0-D4095	<b>Word</b> , Short	Read/Write
	D0-D4094	DWord, Long, Float	
Data Memory As String with HiLo Byte Order	D0.2H-D4095.64H .Bit is string length, range 2 to 64 bytes.	<b>String</b>	Read/Write
Data Memory As String with LoHi Byte Order	D0.2L-D4095.64L .Bit is string length, range 2 to 64 bytes.	<b>String</b>	Read/Write

### String Support

The Toshiba Serial Driver supports reading and writing Data registers as an ASCII string. When using Data registers for string data, each register will contain two bytes of ASCII data. The order of the ASCII data within a given register can be selected when the string is defined. The length of the string can be from 2 to 64 bytes and is entered in place of a bit number. The length must be entered as an even number. The byte order is specified by appending either a "H" or "L" to the address.

### Examples

1. To address a string starting at D200 with a length of 50 bytes and HiLo byte order, enter: D200.50H
2. To address a string starting at D500 with a length of 38 bytes and LoHi byte order, enter: D500.38L

### T3, T3H Addressing

The default data types are shown in **bold**.

Address Type	Range	Data Type	Access
Input Devices	X00...X0F-X5110...X511F	Boolean	Read/Write
Direct Input Devices	I00...I0F-I5110...I511F	Boolean	Read Only
Output Devices	Y00...Y0F-Y5110...Y511F	Boolean	Read/Write
Direct Output Devices	O00...O0F-O5110...O511F	Boolean	Read/Write
Input Registers	XW0-XW511	<b>Word</b> , Short	Read/Write
	XW0-XW510	DWord, Long, Float	
Direct Input Registers	IW0-IW511	<b>Word</b> , Short	Read/Write
	IW0-IW510	DWord, Long, Float	
Output Registers	YW0-YW511	<b>Word</b> , Short	Read/Write
	YW0-YW510	DWord, Long, Float	
Direct Output	OW0-OW511	<b>Word</b> , Short	Read/Write

Address Type	Range	Data Type	Access
Registers	OW0-OW510	DWord, Long, Float	
Link Relays	L00...L0F-L2550...L255F	Boolean	Read/Write
Link Registers	LW0-LW255	<b>Word</b> , Short	Read/Write
	LW0-LW254	DWord, Long, Float	
Link Registers	W0-W2047	<b>Word</b> , Short	Read/Write
	W0-W2046	DWord, Long, Float	
Link Register Relays	Z00...Z0F-Z9990...Z999F	Boolean	Read/Write
File Registers	F0-F8191	<b>Word</b> , Short	Read/Write
	F0-F8190	DWord, Long, Float	
Auxiliary Devices	R00...R0F-R9990...R999F	Boolean	Read/Write
Auxiliary Registers	RW0-RW999	<b>Word</b> , Short	Read/Write
	RW0-RW998	DWord, Long, Float	
Special Devices	S00...S0F-S2550...S255F	Boolean	Read/Write
Special Registers	SW0-SW255	<b>Word</b> , Short	Read Only
	SW0-SW254	DWord, Long, Float	
Counter Registers	C0-C511	<b>Word</b> , Short	Read/Write
Counter Devices	C.0-C.511	Boolean	Read Only
Timer Registers	T0-T999	<b>Word</b> , Short	Read/Write
Timer Devices	T.0-T.999	Boolean	Read Only
Data Memory	D0-D8191	<b>Word</b> , Short	Read/Write
	D0-D8190	DWord, Long, Float	
Data Memory As String with HiLo Byte Order	D0.2H-D8191.64H .Bit is string length, range 2 to 64 bytes.	<b>String</b>	Read/Write
Data Memory As String with LoHi Byte Order	D0.2L-D8191.64L .Bit is string length, range 2 to 64 bytes.	<b>String</b>	Read/Write

### String Support

The Toshiba Serial Driver supports reading and writing Data registers as an ASCII string. When using Data registers for string data, each register will contain two bytes of ASCII data. The order of the ASCII data within a given register can be selected when the string is defined. The length of the string can be from 2 to 64 bytes and is entered in place of a bit number. The length must be entered as an even number. The byte order is specified by appending either a "H" or "L" to the address.

### Examples

1. To address a string starting at D200 with a length of 50 bytes and HiLo byte order, enter: D200.50H
2. To address a string starting at D500 with a length of 38 bytes and LoHi byte order, enter: D500.38L



## Error Descriptions

---

The following error/warning messages may be generated. Click on the link for a description of the message.

### Address Validation

#### [Missing address](#)

[Device address '<address>' contains a syntax error](#)

[Address '<address>' is out of range for the specified device or register](#)

[Device address '<address>' is not supported by model '<model name>'](#)

[Data Type '<type>' is not valid for device address '<address>'](#)

[Device address '<address>' is Read Only](#)

### Serial Communications

[COMn does not exist](#)

[Error opening COMn](#)

[COMn is in use by another application](#)

[Unable to set comm properties on COMn](#)

[Communications error on '<channel name>' \[<error mask>\]](#)

### Device Status Messages

[Device '<device name>' is not responding](#)

[Unable to write to '<address>' on device '<device name>'](#)

## Missing address

---

### Error Type:

Warning

### Possible Cause:

A tag address that has been specified dynamically has no length.

### Solution:

Re-enter the address in the client application.

## Device address '<address>' contains a syntax error

---

### Error Type:

Warning

### Possible Cause:

A tag address that has been specified dynamically contains one or more invalid characters.

### Solution:

Re-enter the address in the client application.

## Address '<address>' is out of range for the specified device or register

---

### Error Type:

Warning

**Possible Cause:**

A tag address that has been specified dynamically references a location that is beyond the range of supported locations for the device.

**Solution:**

Verify the address is correct; if it is not, re-enter it in the client application.

---

**Data Type '<type>' is not valid for device address '<address>'**

---

**Error Type:**

Warning

**Possible Cause:**

A tag address that has been specified dynamically has been assigned an invalid data type.

**Solution:**

Modify the requested data type in the client application.

---

**Device address '<address>' is not supported by model '<model name>'**

---

**Error Type:**

Warning

**Possible Cause:**

A tag address that has been specified dynamically references a location that is valid for the communications protocol but not supported by the target device.

**Solution:**

Verify the address is correct; if it is not, re-enter it in the client application. Also verify the selected model name for the device is correct.

---

**Device address '<address>' is Read Only**

---

**Error Type:**

Warning

**Possible Cause:**

A tag address that has been specified dynamically has a requested access mode that is not compatible with what the device supports for that address.

**Solution:**

Change the access mode in the client application.

---

**COMn does not exist**

---

**Error Type:**

Fatal

**Possible Cause:**

The specified COM port is not present on the target computer.

**Solution:**

Verify that the proper COM port has been selected.

**Error opening COMn**

---

**Error Type:**

Fatal

**Possible Cause:**

The specified COM port could not be opened due an internal hardware or software problem on the target computer.

**Solution:**

Verify that the COM port is functional and may be accessed by other Windows applications.

**COMn is in use by another application**

---

**Error Type:**

Fatal

**Possible Cause:**

The serial port assigned to a device is being used by another application.

**Solution:**

Verify that the correct port has been assigned to the channel.

**Unable to set comm properties on COMn**

---

**Error Type:**

Fatal

**Possible Cause:**

The serial properties for the specified COM port are not valid.

**Solution:**

Verify the serial properties and make any necessary changes.

**Communications error on '<channel name>' [<error mask>]**

---

**Error Type:**

Serious

**Error Mask Definitions:**

**B** = Hardware break detected.

**F** = Framing error.

**E** = I/O error.

**O** = Character buffer overrun.

**R** = RX buffer overrun.

**P** = Received byte parity error.

**T** = TX buffer full.

**Possible Cause:**

1. The serial connection between the device and the Host PC is bad.
2. The communications properties for the serial connection are incorrect.

**Solution:**

1. Verify the cabling between the PC and the PLC device.
2. Verify that the specified communications properties match those of the device.

**Device '<device name>' is not responding**

---

**Error Type:**

Serious

**Possible Cause:**

1. The named device may not be connected to the PLC network.
2. The named device may have been assigned an incorrect Network ID.
3. The response from the device took longer to receive than the amount of time specified in the "Request Timeout" device property.

**Solution:**

1. Check the PLC network connections.
2. Verify the Network ID given to the named device matches that of the actual device.
3. Increase the Request Timeout property so that the entire response can be handled.

**Unable to write to address '<address>' on device '<device name>'**

---

**Error Type:**

Serious

**Possible Cause:**

1. The serial connection between the device and the Host PC is broken.
2. The communications properties for the serial connection are incorrect.
3. The named device may have been assigned an incorrect Network ID.

**Solution:**

1. Verify the cabling between the PC and the PLC device.
2. Verify the specified communications properties match those of the device.
3. Verify that the Network ID given to the named device matches that of the actual device.

# Index

## A

Address '<address>' is out of range for the specified device or register 25

Address Descriptions 17

Attempts Before Timeout 14

Auto-Demotion 14

Auto-Dial 9

## B

Baud Rate 8

Boolean 16

## C

Cable Connections 5

Channel Assignment 11

Channel Properties — Advanced 10

Channel Properties — General 6

Channel Properties — Serial Communications 7

Channel Properties — Write Optimizations 9

Close Idle Connection 9

COM ID 8

COM Port 7

Communication Parameters 4

Communication Protocol 4

Communications error on '<channel name>' [<error mask>] 27

Communications Timeouts 13

COMn does not exist 26

COMn is in use by another application 27

Connect Timeout 9, 14

Connection Type 7

## D

Data Bits 8

---

Data Collection 12  
Data Type '<type>' is not valid for device address '<address>' 26  
Data Types Description 16  
Demote on Failure 15  
Demotion Period 15  
Device '<device name>' not responding 28  
Device address '<address>' contains a syntax error 25  
Device address '<address>' is not supported by model '<model name>' 26  
Device address '<address>' is Read Only 26  
Device ID 5  
Device Properties — Auto-Demotion 14  
Device Properties — General 11  
Device Properties — Redundancy 15  
Device Properties — Timing 13  
Device Setup 4  
Diagnostics 6  
Discard Requests when Demoted 15  
Do Not Scan, Demand Poll Only 13  
Driver 11  
Drop 8  
DTR 8  
Duty Cycle 10  
DWord 16

## **E**

Error Descriptions 25  
Error opening COMn 27  
EX100 Addressing 17  
EX200 Addressing 18  
EX500 Addressing 19

## **F**

Flow Control 8  
Framing 27

**G**

General 11

**I**

ID 12

Identification 6, 11

Idle Time to Close 9

Initial Updates from Cache 13

Inter-Device Delay 11

**L**

Long 16

**M**

Mask 27

Missing address 25

Model 11

Modem 8-9

Modem Settings 9

**N**

Name 11

Non-Normalized Float Handling 10

None 7

**O**

Operating Mode 12

Operation with no Communications 9

Operational Behavior 8

Optimization Method 9

Overrun 27

Overview 4

## **P**

Parameters 4

Parity 8, 27

Physical Medium 7

Poll Delay 8

Protocol 4

## **R**

Raise 8

Read Processing 9

Redundancy 15

Replace with Zero 10

Report Communication Errors 8-9

Request Timeout 14

Respect Tag-Specified Scan Rate 13

RS-485 8

RTS 8

## **S**

Scan Mode 13

Serial Communications 7

Serial Port Settings 8

Shared 8

Short 16

Simulated 12

Stop Bits 8

## **T**

T1, T1 Super Addressing 20

T2 Addressing 21

T3, T3H Addressing 22

Tag Counts 7, 12



Timeouts to Demote 15

Timing 13

## **U**

Unable to set comm properties on COMn 27

Unable to write to address '<address>' on device '<device name>' 28

Unmodified 10

## **W**

Word 16

Write All Values for All Tags 9

Write Only Latest Value for All Tags 10

Write Only Latest Value for Non-Boolean Tags 10